

May 2018

CSB400 Series Commercial / Industrial Pressure Reducing Regulators

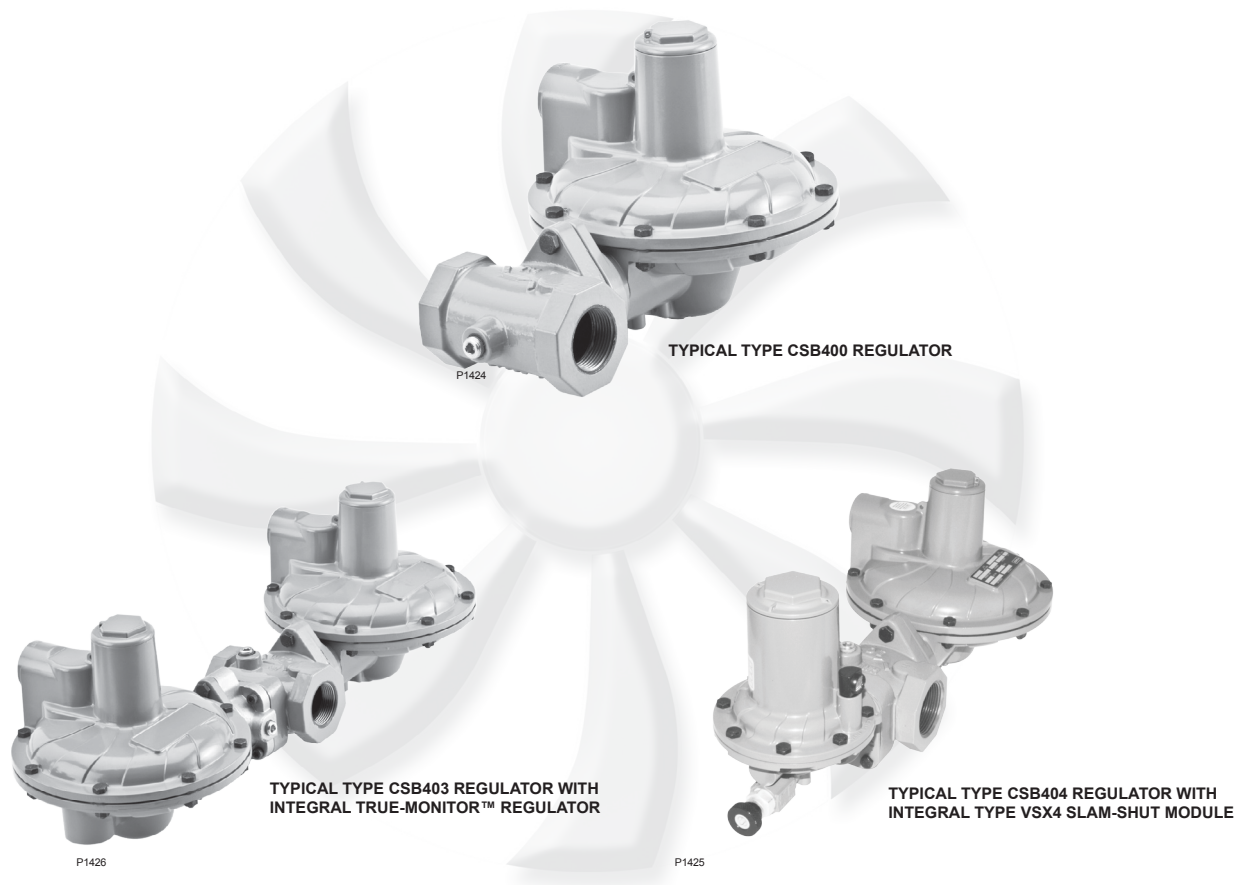


Figure 1. Typical CSB400 Series Pressure Reducing Regulators

Table of Contents

| | |
|--|----|
| Introduction..... | 1 |
| Specifications | 2 |
| Principle of Operation..... | 8 |
| Installation and Overpressure Protection | 11 |
| Commissioning | 15 |
| Adjustment..... | 15 |
| Shutdown..... | 17 |
| Maintenance and Inspection..... | 19 |
| Parts Ordering | 20 |
| Parts List..... | 21 |

Introduction

Scope of the Manual

This Instruction Manual provides installation, maintenance and parts ordering information for the CSB400 Series regulators. Instructions and parts lists for other equipment mentioned in this instruction manual are found in separate manuals.

CSB400 Series

Specifications

The Specifications section lists the specifications for the CSB400 Series Regulators. The following information is stamped on the nameplate of CSB400 Series: Type and Class, Maximum Outlet Pressure and Spring Range.

Available Configurations

See Table 1

Regulator Type: Differential Strength (DS)

Accuracy Class: Up to AC5
(depending on Outlet Pressure)

Lock-up Class: Up to SG10
(depending on Outlet Pressure)

Failure Mode: Fail Open (FO)

Body Sizes and End Connection Styles

See Table 5

Integral Strength (IS) Pressure Ratings⁽¹⁾

See Table 3

Differential Strength (DS) Pressure Ratings and Flow and Sizing Coefficients⁽¹⁾

See Table 4

Operating Pressure Ranges⁽¹⁾

Regulator: See Table 6

Integral True-Monitor™ Module: See Table 7

Slam-Shut Module: See Tables 8a, 8b, 8c and 8d

Maximum Outlet Pressures⁽¹⁾

Emergency: 4.0 bar / 58 psig

To Avoid Internal Parts Damage:

Type CSB450: 1 bar / 14.5 psig above outlet pressure setting

All other Types: 0.34 bar / 5 psig above outlet pressure setting

Operating: 3.0 bar / 43.5 psig

Spring Case Vent Connection

1 NPT

Orifice Size

17.5 mm / 11/16 in.

Pressure Registration

Internal, External or Dual (Internal and External)

Operating Temperature (TS)⁽¹⁾⁽²⁾

According to PED Standards:

All Types: -20 to 66°C / -4 to 150°F

Non-PED with standard construction:

Types CSB400/CSB404, CSB420/CSB424:

-20 to 66°C / -4 to 150°F

Types CSB450/CSB454⁽³⁾:

-30 to 66°C / -22 to 150°F

Non-PED with low temperature construction:

Types CSB400F/CSB404F⁽³⁾, CSB420F/CSB424F⁽³⁾:

-30 to 66°C / -22 to 150°F

Approximate Weights

With Threaded body

Type CSB400: 4.1 kg / 9 lbs

Type CSB403: 9.1 kg / 20 lbs

Type CSB404: 5.0 kg / 11 lbs

With Flanged Body:

Add 4.1 kg / 9 lbs to threaded weights listed above

PED Conformity Statement and Information

The CSB400 Product Series is in conformity with the Pressure Equipment Directive PED 2014/68/EU. The exceptions to this previous statement are the Types CSB403 and CSB423. Both of these types are not yet certified to conform with the PED Directive.

Pressure regulator does not require any supplementary upstream safety accessory for protection against overpressure compared with its design pressure PS, when upstream reducing station is sized for a max downstream incidental $MIP_d \leq 1.1 P_S$.

PED Related Information

See Table 2

1. The pressure/temperature limits in this Instruction Manual or any applicable standard limitation should not be exceeded.

2. Standard token relief set values listed in Table 8 are based on -20 to 60°C / -4 to 140°F.

3. Product has passed Emerson Process Management Regulator Technologies, Inc. (Emerson) testing for lockup, relief start-to-discharge and reseal down to -40°.

Table 1. Available Configurations

| TYPE NUMBER | | | | | OPTION |
|--|---|---|----|--|---|
| C | S | B | 4 | | |
| | | | | | PRESSURE CONSTRUCTION AND UPSTREAM MONITOR APPLICATIONS |
| | | | 0 | | Low Pressure Applications (Outlet Pressure: 17 to 100 mbar / 7 to 40 in. w.c.) |
| | | | 1 | | Low Pressure, Upstream Monitoring Applications ⁽¹⁾⁽³⁾ (Outlet Pressure: 17 to 100 mbar / 7 to 40 in. w.c.) |
| | | | 2 | | Medium Pressure Applications (Outlet Pressure: 100 to 517 mbar / 40 to 208 in. w.c.) |
| | | | 3 | | Medium Pressure, Upstream Monitoring Applications ⁽¹⁾⁽³⁾ (Outlet Pressure: 100 to 517 mbar / 40 to 208 in. w.c.) |
| | | | 5 | | High Pressure Applications ⁽²⁾ (Outlet Pressure: 0.50 to 3.0 bar / 7 to 43.5 psig) |
| | | | | | OVERPRESSURE PROTECTION |
| | | | 0 | | Without Overpressure Protection Module |
| | | | 0F | | Low Temperature Capability, Without Overpressure Protection Module |
| | | | 3 | | With Integral True-Monitor™ Module ⁽⁴⁾ |
| | | | 3F | | Low Temperature Capability, With Integral True-Monitor Module ⁽⁴⁾ |
| | | | 4 | | With Type VSX4 Slam-shut Module ⁽⁵⁾ |
| | | | 4F | | Low Temperature Capability, With Type VSX4 Slam-shut Module ⁽⁵⁾ |
| | | | | | PRESSURE REGISTRATION |
| | | | D | | Dual Registration (Best solution for quick changing loads) |
| | | | E | | External Registration |
| | | | I | | Internal Registration |
| | | | | | RELIEF |
| | | | N | | No Relief |
| | | | T | | Internal Token Relief |
| Example: Type number CSB424DT : Type CSB400 regulator constructed for medium pressure applications, with Type VSX4 slam-shut module, Dual pressure registration and Internal Token relief. 1. Not available with Integral True-Monitor option. 2. Not available with Integral True-Monitor or Token Relief option. 3. Available with External Pressure Registration only. 4. Reference Instruction Manual D103126X012 for information regarding the Type TM600 Integral True-Monitor module. 5. Reference Instruction Manual D103127X012 for information regarding the Type VSX4 Slam-Shut module. | | | | | |



WARNING

Failure to follow these instructions or to properly install and maintain this equipment could result in an explosion and/or fire causing property damage and personal injury or death.

Fisher™ regulators must be installed, operated and maintained in accordance with federal, state and local codes, rules and regulations and Emerson instructions.

If the regulator vents gas or a leak develops in the system, service to the unit may be required. Failure to correct trouble could result in a hazardous condition.



Call a gas service person to service the unit. Only a qualified person must install or service the regulator.

Description

CSB400 Series regulators are typically installed on industrial and commercial applications. See Table 1 for Available Configurations. Low, Medium and High outlet pressure constructions are available via Types CSB400, CSB420 and CSB450, respectively, that provide outlet setpoints ranging from 17 mbar to 3.0 bar / 7 in. w.c. to 43.5 psig. Also available are upstream monitoring configurations such as Types CSB410 and CSB430, which are installed upstream of the primary regulator to provide overpressure protection.

Types that include an “F” refer to the cold temperature construction of the base Type number. For example, the Type CSB404F provides a cold temperature construction of the Type CSB404. Refer to the Operating Temperature section found on the following page for additional information regarding temperature capabilities and refer to Table 7 for inlet pressure limitations. For types that include an “F”, refer to the base type number for general information such as Principles of Operation, Maintenance instructions, Warnings and Cautionary notes.

CSB400 Series

| | | | | | | |
|--|-------------------------|----------------------------------|---------------------------|---------------------------|----------------------|--|
|  PATENT PENDING  0062 | REGULATOR | | SLAM SHUT | | SERIAL NO. | |
| | <input type="text"/> | | <input type="text"/> | | <input type="text"/> | |
| | TS <input type="text"/> | TEMP CLASS <input type="text"/> | | DOM <input type="text"/> | | |
| | PS <input type="text"/> | FLUID GROUP <input type="text"/> | CAT <input type="text"/> | LOC <input type="text"/> | | |
| | DN <input type="text"/> | SEAT <input type="text"/> | BODY <input type="text"/> | MATL <input type="text"/> | | |
| PN <input type="text"/> | | ϕ <input type="text"/> | | | | |

| | | |
|---|-----------------------------------|--------------------------------|
| Std: EN334 REGULATOR PED mfg: Chartres, France | TYPE <input type="text"/> | PSD <input type="text"/> |
| | Pumax <input type="text"/> | Pmax <input type="text"/> |
| | Wds <input type="text"/> | Matl Case <input type="text"/> |
| | Failure Mode <input type="text"/> | |

REGULATOR NAMEPLATES

| | | |
|---|--------------------------------|------------------------------|
| Std: EN14382 SLAM SHUT PED mfg: Chartres, France | RELAIS <input type="text"/> | Pu Max <input type="text"/> |
| | RELAY <input type="text"/> | Max IN <input type="text"/> |
| | MATL CASE <input type="text"/> | P max <input type="text"/> |
| | | Max OUT <input type="text"/> |
| | TYPE <input type="text"/> | PSD <input type="text"/> |
| | CLASS <input type="text"/> | |
| Wdso <input type="text"/> | Wdsu <input type="text"/> | |
| OP range <input type="text"/> | UP range <input type="text"/> | |

| | | | |
|-----------------------------------|-----------------------------|---------------------------------|---------------------------------|
| FISHER | | TYPE NO. <input type="text"/> | SERIAL NO. <input type="text"/> |
| PATENT PENDING | DOM <input type="text"/> | RELIEF <input type="text"/> | |
| LOC <input type="text"/> | MAX IN <input type="text"/> | ORIFICE <input type="text"/> | SPG RANGE <input type="text"/> |
| MAX EMER OUT <input type="text"/> | | MAX OP OUT <input type="text"/> | |

SLAM-SHUT NAMEPLATE

INTEGRAL TRUE-MONITOR NAMEPLATE

Figure 2. CSB400 Series Regulator, Slam-shut and Integral True-Monitor™ Nameplates and Labels

Table 2. PED Information

| TYPE | DESCRIPTION | PED CATEGORY | FLUID GROUP |
|---|---------------------------------|------------------|--|
| CSB400, CSB400F, CSB410, CSB420, CSB420F, CSB430 and CSB450 | Base regulator | I | Groups 1 and 2 according to PED 2014/68/EU, 1st and 2nd family gas according to EN 437 or other gases (compressed air, nitrogen). The gas must be non-corrosive, clean (filtration on inlet side necessary) and dry. |
| CSB404, CSB404F, CSB414, CSB424, CSB424F, CSB434 and CSB454 | Regulator with Slam-Shut Module | IV | |
| European EN Reference Standards | | EN 334, EN 14382 | |

Table 3. Integral Strength (IS) Pressure Ratings

| TYPE | MAXIMUM ALLOWABLE PRESSURE ⁽¹⁾ / MAXIMUM EMERGENCY INLET PRESSURE | | MAXIMUM OPERATING INLET PRESSURE ⁽¹⁾ | |
|-------------------------------------|--|------|---|------|
| | P _s | | P _{umax} | |
| | bar | psig | bar | psig |
| CSB400, CSB400F, CSB404 and CSB404F | 4.0 | 58 | 4.0 | 58 |
| CSB420, CSB420F, CSB424 and CSB424F | | | | |
| CSB450 and CSB454 | | | | |
| CSB410 and CSB414 | | | | |
| CSB403, CSB403F, CSB423 and CSB423F | | | | |
| CSB403 and CSB423 | | | | |

1. For the Integral Strength (IS) version, the maximum value of P_s and P_{umax} should be similar to the PSD used for the Differential Strength (DS) version.

Table 4. Differential Strength (DS) Pressure Ratings and Flow and Sizing Coefficients

| TYPE | SPECIFIC MAXIMUM ALLOWABLE PRESSURE / MAXIMUM EMERGENCY OUTLET PRESSURE | | MAXIMUM OPERATING INLET PRESSURE | | MAXIMUM EMERGENCY INLET PRESSURE ⁽¹⁾ | | ORIFICE SIZE | | FLOW COEFFICIENTS WIDE OPEN | | | IEC SIZING COEFFICIENTS | | |
|---------------------|---|------|----------------------------------|------|---|------|--------------|-------|-----------------------------|----------------|----------------|-------------------------|----------------|----------------|
| | PSD | | P _{umax} | | P _s | | | | | | | | | |
| | bar | psig | bar | psig | bar | psig | mm | In. | C _g | C _v | C _i | X _T | F _D | F _L |
| CSB400F and CSB404F | 4.0 | 58 | 6.0 | 87 | 12.0 | 174 | 17.5 | 11/16 | 428 | 11 | 43 | 1.16 | 0.84 | 0.90 |
| CSB403F and CSB423F | | | 6.0 | 87 | 10.0 | 145 | | | | | | | | |
| CSB403 and CSB423 | | | 10.0 | 145 | 10.0 | 145 | | | | | | | | |
| CSB410 and CSB414 | | | 10.0 | 145 | 12.0 | 174 | | | | | | | | |
| CSB430 and CSB434 | | | 10.0 | 145 | 12.0 | 174 | | | | | | | | |
| CSB400 and CSB404 | | | 10.0 | 145 | 12.0 | 174 | | | | | | | | |
| CSB420F and CSB424F | | | 16.0 | 232 | 20.0 | 290 | | | | | | | | |
| CSB420 and CSB424 | | | 16.0 | 232 | 20.0 | 290 | | | | | | | | |
| CSB450 and CSB454 | | | 16.0 | 232 | 20.0 | 290 | | | | | | | | |

1. If ordered with a PN 16 flanged connection, P_s rating is a maximum of 16.0 bar / 232 psig. P_s rating may be lower than 16.0 bar / 232 psig as indicated by this table.

Table 5. Body Sizes, Materials, End Connections and Maximum Cold Working Pressure Ratings⁽¹⁾

| BODY MATERIAL | INLET SIZE, NPS | OUTLET SIZE, NPS | END CONNECTION | FACE-TO-FACE DIMENSION | | BODY PRESSURE RATING | |
|---------------|------------------------------|------------------------------|----------------|------------------------|------|----------------------|------|
| | | | | mm | In. | bar | psig |
| Ductile Iron | 1 | 1 | NPT | 100 | 4 | 17.2 | 250 |
| | 1-1/4 | 1-1/4 | | 114 | 4.5 | | |
| | 1-1/2 | 1-1/2 | | 114 | 4.5 | | |
| | 2 | 2 | | 127 | 5 | | |
| | 1 | 1 | Rp | 100 | 4 | | |
| | 1 | 1-1/4 | | 114 | 4.5 | | |
| | 1-1/4 | 1-1/4 | | 114 | 4.5 | | |
| | 1-1/2 | 1-1/2 | | 114 | 4.5 | | |
| | 2 | 2 | | 127 | 5 | | |
| | DN 50 / 2 | DN 50 / 2 | CL150 FF | 254 | 10 | 16.0 | 232 |
| | | | PN 10/16 | 254 | 10 | | |
| | DN 40 / 1-1/2 ⁽²⁾ | DN 40 / 1-1/2 ⁽²⁾ | PN 16 Slip-On | 184 | 7.24 | | |
| WCC Steel | 1 | 2-1/4 | Rp x GAZ | 105 | 4.1 | 20.0 | 290 |
| | 1 | 1 | | 100 | 4 | | |
| | 1-1/4 | 1-1/4 | | 114 | 4.5 | | |
| | 1-1/2 | 1-1/2 | NPT | 114 | 4.5 | | |
| | 1 | 1 | | 100 | 4 | | |
| | 1-1/4 | 1-1/4 | | 114 | 4.5 | | |
| | 1-1/2 | 1-1/2 | | 114 | 4.5 | | |
| | 1-1/2 | 1-1/2 | | 114 | 4.5 | | |

1. The pressure/temperature limits in this Instruction Manual or any applicable standard or code limitation should not be exceeded.

2. Uses Rp 1-1/2 x 1-1/2 threaded body with PN 16 slip-on flanges.

Table 6. CSB400 Series Primary Regulator Outlet Pressure Ranges

| TYPE | OPERATING PRESSURE RANGE, W _a | | PART NUMBER | SPRING COLOR | SPRING WIRE DIAMETER | | SPRING FREE LENGTH | |
|--|--|-------------------|-------------|---------------|----------------------|-------|--------------------|------|
| | mbar | In. w.c. | | | mm | In. | mm | In. |
| CSB400, CSB400F, CSB403, CSB403F, CSB404, CSB404F, CSB410 and CSB414 | 17 to 24 | 6.8 to 9.6 | GE30191X012 | Pink | 2.03 | 0.080 | 152 | 6.00 |
| | 24 to 35 | 9.6 to 14 | GE43955X012 | Orange Stripe | 2.19 | 0.086 | 110 | 4.35 |
| | 35 to 60 | 14 to 24.1 | GE30201X012 | Dark Green | 3.23 | 0.127 | 110 | 4.35 |
| | 54 to 100 | 21.7 to 40 | GE30202X012 | Tan | 2.85 | 0.112 | 127 | 5.00 |
| CSB420, CSB420F, CSB423, CSB423F, CSB424, CSB424F, CSB430 and CSB434 | 100 to 160 | 1.45 to 2.3 psig | GE35081X012 | Purple Stripe | 3.86 | 0.152 | 124 | 4.90 |
| | 138 to 300 | 2.0 to 4.4 psig | GE30192X012 | Dark Blue | 4.27 | 0.168 | 118 | 4.65 |
| | 276 to 517 | 4 to 7.5 psig | GE33121X012 | Red | 4.93 | 0.194 | 118 | 4.65 |
| CSB450 and CSB454 | 500 mbar to 1 bar | 7.3 to 14.5 psig | GE30203X012 | Light Blue | 5.59 | 0.220 | 102 | 4.00 |
| | 1 to 3 bar | 14.5 to 43.5 psig | GE30204X012 | Light Green | 6.73 | 0.265 | 100 | 3.95 |

Table 7. Primary Regulator and Integral True-Monitor™ Outlet Pressure Ranges

| TYPE | PRIMARY REGULATOR | | | | | | | INTEGRAL TRUE-MONITOR | | | | | | | |
|-------------------|-------------------|------------|--------------------|--------------------|---------------|-------------|---|-----------------------|------------|---------------------------------|------------|--------------|------------------|-----------|-------------|
| | Factory Setpoint | | Set Pressure Range | | Color | P/N | Factory Token Relief Set ⁽¹⁾ | | | Factory Setpoint ⁽¹⁾ | | Spring Range | | Color | P/N |
| | mbar | psig | mbar | psig | | | % of REG. Set | mbar | psig | mbar | psig | mbar | psig | | |
| CSB403 and CB403F | 20 | 8 in w.c. | 17 to 24 | 6.8 to 9.6 in w.c. | Pink | GE30191X012 | No Token Relief | | | 37 | 15 in w.c. | 30 to 52 | 12 to 21 in w.c. | Blue | GE30189X012 |
| | | | | | | | 170% | 35 | 14 in w.c. | | | | | | |
| | 30 | 12 in w.c. | 24 to 35 | 9.6 to 14 in w.c. | Orange Stripe | GE43955X012 | No Token Relief | | | 52 | 21 in w.c. | 45 to 75 | 18 to 30 in w.c. | Green | GE30196X012 |
| | | | | | | | 150% | 45 | 18 in w.c. | | | | | | |
| | 50 | 20 in w.c. | 35 to 60 | 14 to 24 in w.c. | Dark Green | GE30201X012 | No Token Relief | | | 70 | 1 | 65 to 99 | 26 to 40 in w.c. | Orange | GE30225X012 |
| | | | | | | | 140% | 70 | 1 | | | | | | |
| | 69 | 1 | 54 to 100 | 0.78 to 1.45 | Tan | GE30202X012 | No Token Relief | | | 103 | 1.5 | 97 to 200 | 1.4 to 2.9 | Black | GE30190X012 |
| | | | | | | | 130% | 90 | 1.3 | | | | | | |
| CSB423 and CB423F | 138 | 2 | 100 to 160 | 1.45 to 2.3 | Purple Stripe | GE35081X012 | No Token Relief | | | 172 | 2.5 | 97 to 200 | | | |
| | | | | | | | 130% | 180 | 2.6 | | | | | | |
| | 207 | 3 | 138 to 300 | 2.0 to 4.4 | Dark Blue | GE30192X012 | No Token Relief | | | 276 | 4 | 248 to 414 | 3.6 to 6 | Dark Blue | GE30192X012 |
| | | | | | | | 125% | 260 | 3.8 | | | | | | |
| | 345 | 5 | 276 to 517 | 4 to 7.5 | Red | GE33121X012 | No Token Relief | | | 414 | 6 | 352 to 517 | 5.1 to 7.5 | Red | GE33121X012 |
| | | | | | | | 125% | 430 | 6.25 | | | | | | |


1. Recommended minimum Integral True-Monitor setpoints shown.

CSB400 Series

Table 8a. Type CSB404 Overpressure Shut-off – North American OPSO Ranges

| REGULATOR | | | SLAM SHUT DEVICE | | | | | | |
|------------------|------------------|---------------------------|--------------------------------------|------------------|---|------|--|---|---------------------|
| Type Number | Typical Setpoint | Spring Range | Type Number (Max Operating Inlet) | Token Relief Set | Relief Range Shown as a % of Regulator Setpoint | | Minimum Required Difference Between Token Relief and OPSO | Over Pressure Shut-Off (OPSO) Set Range | Factory Set OPSO |
| | psig | psig | | psig | min ⁽¹⁾ | max | psig | psig | psig |
| CSB404F | 7 in. w.c. | 6.8 to 9.6 in. w.c. | VSX4L (125 psi) | 0.49 | 170% | 215% | 0.12 | 12 to 24 in. w.c. | 22 in. w.c. |
| | 11 in. w.c. | 9.7 to 14 in. w.c. | | 0.59 | 150% | 160% | 0.12 | 16 in. w.c. to 1.6 psig | 25 in. w.c. |
| | 14 in. w.c. | 14 to 24.1 in. w.c. | | 1 | 140% | 158% | 0.23 | 24 in. w.c. to 2.8 psig | 1.1 |
| | 1 | 21.7 in. w.c. to 1.4 psig | | 1.4 | 130% | 140% | 0.29 | 1.4 to 4.1 | 2 |
| CSB424F | 2 | 1.5 to 2.3 | | 2.8 | 130% | 140% | 0.58 | 2.0 to 7.3 | 3.5 |
| | 3 | 2.0 to 4.4 | | 5.4 | 125% | 140% | 0.73 | | 5 |
| | 5 | 4.0 to 7.5 | | 8.9 | 123% | 140% | 0.87 | | 3.2 to 11.0 |
| CSB404 CSB414 | 7 in. w.c. | 6.8 to 9.6 in. w.c. | VSX4L (232 psi) | 0.49 | 170% | 215% | 0.12 | 12 to 24 in. w.c. | 22 in. w.c. |
| | 11 in. w.c. | 9.7 to 14 in. w.c. | | 0.59 | 150% | 160% | 0.12 | 16 in. w.c. to 1.6 psig | 25 in. w.c. |
| | 14 in. w.c. | 14 to 24.1 in. w.c. | | 1 | 140% | 158% | 0.23 | 24 in. w.c. to 2.8 psig | 1.1 |
| | 1 | 21.7 in. w.c. to 1.4 psig | | 1.4 | 130% | 140% | 0.29 | 1.4 to 4.1 | 2 |
| CSB424 CSB434 | 2 | 1.45 to 2.3 | | 2.8 | 130% | 140% | 0.58 | 2.0 to 7.3 | 3.5 |
| | 3 | 2.0 to 4.4 | | 5.4 | 125% | 140% | 0.73 | | 5 |
| | 5 | 4.0 to 7.5 | | 8.9 | 123% | 140% | 0.87 | | 3.2 to 11.0 |
| CSB454 | 10 | 7.3 to 14.5 | VSX4H (232 psi) | | | | | 5.8 to 16.3 | 12 |
| | 15 | 14.5 to 43.5 | | | | | | 13.1 to 43.5 | 19 |
| | 20 | | | | | | | | 25 |
| | 30 | | | | | | | | 35 |
| | 40 | | | | | | | | 45 |

Standard factory set shown. Factory set is at the minimum value of the range indicated. Range indicated is a percentage of setpoint. Percentage indicated is based on the set pressure range in which that setpoint resides. If non-standard sets are required, adherence must be made to constrain shown in above table, including token relief set range and OPSO set range and minimum required difference between token relief and OPSO set.

 – Gray areas indicate that token relief is not available above 5 psig setpoint.

1. Minimum token relief values apply -20°C / -4°F service temperatures and above. For service below -20°C / -4°F, add 8 mbar / 0.12 psig to the minimum token relief value listed.

2. Maximum OPSO set point truncated to reflect maximum outlet pressure for spring range.

Table 8b. Type CSB404 Overpressure Shut-off – European OPSO Ranges

| REGULATOR | | | SLAM SHUT DEVICE | | | | | | |
|--|------------------|--------------|--------------------------------------|------------------|---|------|---|---|------------------|
| Type Number | Typical Setpoint | Spring Range | Type Number (Max Operating Inlet) | Token Relief Set | Relief Range Shown as a % of Regulator Setpoint | | Minimum Required Difference Between Token Relief and OPSO | Over Pressure Shut-Off (OPSO) Set Range | Factory Set OPSO |
| | mbar | mbar | | mbar | min ⁽¹⁾ | max | mbar | mbar | mbar |
| CSB404F | 20 | 17 to 24 | VSX4L (8.6 bar) | 34 | 170% | 215% | 8 | 30 to 60 | 40 |
| | 21 | | | 36 | | | | | 45 |
| | 27 | | | 41 | | | | | 46 |
| | 30 | 24 to 35 | | 45 | 150% | 160% | 10 | 30 to 60 | 60 |
| | 35 | | | 53 | | | | | 67 |
| | 50 | | | 70 | | | | | 90 |
| | 60 | 35 to 60 | | 84 | 140% | 158% | 16 | 60 to 193 | 104 |
| | 75 | | | 98 | | | | | 128 |
| | 100 | | | 130 | | | | | 170 |
| CSB424F | 300 | 138 to 300 | 375 | 125% | 140% | 50 | 138 to 500 | 450 | |
| CSB404 CSB414 | 20 | 17 to 24 | VSX4L (16 bar) | 34 | 170% | 215% | 8 | 30 to 60 | 40 |
| | 21 | | | 36 | | | | | 45 |
| | 27 | | | 41 | | | | | 46 |
| | 30 | 24 to 35 | | 45 | 150% | 160% | 10 | 30 to 60 | 60 |
| | 35 | | | 53 | | | | | 67 |
| | 50 | | | 70 | | | | | 90 |
| | 60 | 35 to 60 | | 84 | 140% | 158% | 16 | 60 to 193 | 105 |
| | 75 | | | 98 | | | | | 130 |
| | 100 | | | 130 | | | | | 170 |
| CSB424 CSB434 | 150 | 100 to 160 | 195 | 130% | 140% | 40 | 95 to 280 | 248 | |
| | 300 | 138 to 300 | 375 | 125% | 140% | 50 | 138 to 500 | 450 | |
| | 500 | 276 to 517 | 615 | 123% | 140% | 60 | 221 to 760 | 700 | |
| CSB454 | 750 | 500 to 1000 | VSX4H (16 bar) | | | | | 400 to 1450 | 1050 |
| | 1000 | | | | | | | | 1320 |
| | 1200 | 1000 to 3000 | | | | | | 900 to 3000 | 1600 |
| | 1500 | | | | | | | | 1900 |
| | 2000 | | | | | | | | 2400 |
| | 3000 | | | | | | | | 3400 |
| Standard factory set shown. Factory set is at the minimum value of the range indicated. Range indicated is a percentage of setpoint. Percentage indicated is based on the set pressure range in which that setpoint resides. If non-standard sets are required, adherence must be made to constrain shown in above table, including token relief set range and OPSO set range and minimum required difference between token relief and OPSO set. | | | | | | | | | |
| Gray areas indicate that token relief is not available above 345 mbar setpoint. | | | | | | | | | |
| 1. Minimum token relief values apply -20°C / -4°F service temperatures and above. For service below -20°C / -4°F, add 8 mbar / 0.12 psig to the minimum token relief value listed. | | | | | | | | | |

Table 8c. Type CSB404 Over Pressure and Under Pressure Shut-off – North American OPSO and UPSO Ranges

| REGULATOR | | | SLAM SHUT DEVICE | | | | | | | | | |
|--|------------------|---------------------------|-----------------------------------|------------------|---|------|---|--|--|-------------------|-------------------------|-------------------------|
| Type Number | Typical Setpoint | Spring Range | Type Number (Max Operating Inlet) | Token Relief Set | Relief Range Shown as a % of Regulator Setpoint | | Required Difference Between Token Relief and OPSO | Under Pressure Shut-off (UPSO) Set Range | Over Pressure Shut-Off (OPSO) Set Range Over UPSO Setpoint | Factory Set | | |
| | psig | psig | | psig | min ⁽¹⁾ | max | psig | psig | psig | psig | UPSO | Adjusted OPSO Range |
| CSB404F | 7 in. w.c. | 6.8 to 9.6 in. w.c. | VSX4L (125 psi) | 0.49 | 170% | 215% | 0.12 | 3 to 12 in. w.c. | 16 to 29 in. w.c. | 3 in. w.c. | 19 in. w.c. to 1.2 psig | 22 in. w.c. |
| | 11 in. w.c. | 9.7 to 14 in. w.c. | | 0.59 | 150% | 160% | 0.12 | 3 to 12 in. w.c. | 16 to 29 in. w.c. | 6 in. w.c. | 22 in. w.c. to 1.3 psig | 25 in. w.c. |
| | 14 in. w.c. | 14 to 24.1 in. w.c. | | 1 | 140% | 158% | 0.23 | 4 in. w.c. to 1.1 psig | 20 in. w.c. to 1.8 psig | 9 in. w.c. | 1.1 to 2.1 | 1.1 |
| | 1 | 21.7 in. w.c. to 1.4 psig | | 1.4 | 130% | 140% | 0.29 | 10 in. w.c. to 2.3 psig | 1.2 to 3.2 | 14 in. w.c. | 1.7 to 3.7 | 2 |
| CSB424F | 2 | 1.5 to 2.3 | | 2.8 | 130% | 140% | 0.58 | 10 in. w.c. to 2.3 psig | 1.2 to 3.2 | 1 | 2.2 to 4.2 | 3.5 |
| | 3 | 2.0 to 4.4 | | 5.4 | 125% | 140% | 0.73 | 1.5 to 7.3 | 2.6 to 5.6 | 2 | 4.6 to 7.6 | 5 |
| | 5 | 4.0 to 7.5 | | 8.9 | 123% | 140% | 0.87 | | | 3 | 5.6 to 8.6 | 7 |
| CSB404 CSB414 | 7 in. w.c. | 6.8 to 9.6 in. w.c. | | VSX4L (232 psi) | 0.49 | 170% | 215% | 0.12 | 3 to 12 in. w.c. | 18 to 30 in. w.c. | 3 in. w.c. | 21 in. w.c. to 1.2 psig |
| | 11 in. w.c. | 9.7 to 14 in. w.c. | 0.59 | | 150% | 160% | 0.12 | 6 in. w.c. | | | 24 in. w.c. to 1.3 psig | 25 in. w.c. |
| | 14 in. w.c. | 14 to 24.1 in. w.c. | 1 | | 140% | 158% | 0.23 | 4 in. w.c. to 1.1 psig | 25 in. w.c. to 1.9 psig | 9 in. w.c. | 1.2 to 2.2 | 1.1 |
| CSB424 CSB434 | 1 | 21.7 in. w.c. to 1.4 psig | 1.4 | | 130% | 140% | 0.29 | 10 in. w.c. to 2.3 psig | 1.2 to 3.2 | 14 in. w.c. | 1.7 to 3.7 | 2 |
| | 2 | 1.45 to 2.3 | 2.8 | | 130% | 140% | 0.58 | 10 in. w.c. to 2.3 psig | 1.2 to 3.2 | 1 | 2.2 to 4.2 | 3.5 |
| | 3 | 2.0 to 4.4 | 5.4 | | 125% | 140% | 0.73 | 1.5 to 7.3 | 2.6 to 5.6 | 2 | 4.6 to 7.6 | 5 |
| | 5 | 4.0 to 7.5 | 8.9 | | 123% | 140% | 0.87 | | | 3 | 5.6 to 8.6 | 7 |
| CSB454 | 10 | 7.3 to 14.5 | VSX4H (232 psi) | | | | | | 1.5 to 7.3 | 3.5 to 8.2 | 5 | 8.5 to 13.2 |
| | 15 | 14.5 to 43.5 | | 1.5 to 10.9 | | | | | 6.7 to 13.5 | 7 | 13.7 to 20.5 | 19 |
| | 20 | | | 7.3 to 29.0 | | | | | 15.2 to 22.8 | 10 | 25.2 to 32.8 | 25 |
| | 30 | | | | | | | | 15 | 33.1 to 48.4 | 35 | |
| | 40 | | | | | | | | 20 | 38.1 to 53.4 | 45 | |
| Standard factory set shown. Factory set is at the minimum value of the range indicated. Range indicated is a percentage of setpoint. Percentage indicated is based on the set pressure range in which that setpoint resides. If non-standard sets are required, adherence must be made to constrain shown in above table, including token relief set range and OPSO set range and minimum required difference between token relief and OPSO set. | | | | | | | | | | | | |
| Gray areas indicate that token relief is not available above 5 psig setpoint. | | | | | | | | | | | | |
| 1. Minimum token relief values apply -20°C / -4°F service temperatures and above. For service below -20°C / -4°F, add 8 mbar / 0.12 psig to the minimum token relief value listed. | | | | | | | | | | | | |

Table 8d. Type CSB404 Over Pressure and Under Pressure Shut-off – European OPSO and UPSO Ranges

| REGULATOR | | | SLAM SHUT DEVICE | | | | | | | | | |
|---------------|------------------|--------------|-----------------------------------|------------------|---|------|---|--|--|-------------|---------------------|------|
| Type Number | Typical Setpoint | Spring Range | Type Number (Max Operating Inlet) | Token Relief Set | Relief Range Shown as a % of Regulator Setpoint | | Required Difference Between Token Relief and OPSO | Under Pressure Shut-off (UPSO) Set Range | Over Pressure Shut-Off (OPSO) Set Range Over UPSO Setpoint | Factory Set | | |
| | mbar | mbar | | mbar | min ⁽¹⁾ | max | | mbar | mbar | UPSO | Adjusted OPSO Range | OPSO |
| CSB404F | 20 | 17 to 24 | VSX4L (8.6 bar) | 34 | 170% | 215% | 8 | 7 to 11 | 30 to 44 | 10 | 40 to 54 | 40 |
| | 21 | | | 36 | | | | | | 11 | 40 to 54 | 45 |
| | 27 | 24 to 35 | | 41 | | | | 7 to 15 | 32 to 44 | 14 | 46 to 58 | 46 |
| | 30 | 24 to 35 | | 45 | 150% | 160% | 10 | | | 15 | 55 to 87 | 60 |
| | 35 | 35 to 60 | | 53 | | | | 7 to 30 | 40 to 76 | 18 | 58 to 90 | 67 |
| | 50 | | | 70 | | | | | | 25 | 73 to 99 | 90 |
| | 60 | 35 to 60 | | 84 | 140% | 158% | 16 | 10 to 75 | 48 to 74 | 30 | 78 to 104 | 100 |
| | 75 | | | 98 | | | | | | 38 | 88 to 160 | 128 |
| | 100 | 54 to 100 | | 130 | 130% | 140% | 20 | 10 to 75 | 50 to 122 | 50 | 100 to 172 | 170 |
| | | | | | | | | | | | | |
| CSB424F | 300 | 138 to 300 | | 375 | 125% | 140% | 50 | 100 to 500 | 179 to 386 | 150 | 329 to 536 | 450 |
| CSB404 CSB414 | 20 | 17 to 24 | VSX4L (16 bar) | 34 | 170% | 215% | 8 | 7 to 30 | 40 to 55 | 10 | 50 to 65 | 55 |
| | 21 | | | 36 | | | | | | 10 | 50 to 65 | 55 |
| | 27 | 24 to 35 | | 41 | | | | 7 to 30 | 40 to 55 | 14 | 54 to 69 | 55 |
| | 30 | 24 to 35 | | 45 | 150% | 160% | 10 | | | 15 | 60 to 91 | 60 |
| | 35 | 35 to 60 | | 53 | | | | 7 to 30 | 45 to 76 | 18 | 63 to 94 | 70 |
| | 50 | | | 70 | | | | | | 25 | 75 to 105 | 90 |
| | 60 | 35 to 60 | | 84 | 140% | 158% | 16 | 10 to 75 | 50 to 80 | 30 | 80 to 110 | 100 |
| | 75 | | | 98 | | | | | | 38 | 100 to 170 | 128 |
| | 100 | 54 to 100 | | 130 | 130% | 140% | 20 | 10 to 75 | 62 to 132 | 50 | 112 to 182 | 170 |
| | | | | | | | | | | | | |
| CSB424 CSB434 | 150 | 100 to 160 | | 195 | 130% | 140% | 40 | 25 to 160 | 83 to 221 | 75 | 158 to 296 | 248 |
| | 300 | 138 to 300 | | 375 | 125% | 140% | 50 | | | 150 | 329 to 536 | 450 |
| | 500 | 276 to 517 | | 615 | 123% | 140% | 60 | 100 to 500 | 179 to 386 | 250 | 491 to 813 | 700 |
| CSB454 | 750 | 500 to 1000 | VSX4H (16 bar) | | | | | 100 to 750 | 460 to 932 | 375 | 959 to 1432 | 1050 |
| | 1000 | | | | | | | | | 500 | 960 to 1432 | 1320 |
| | 1200 | | | | | | | 500 to 2000 | 1050 to 1570 | 600 | 1650 to 2170 | 1650 |
| | 1500 | 1000 to 3000 | | | | | | | | 750 | 1800 to 2320 | 1900 |
| | 2000 | | | | | | | 500 to 2000 | 1250 to 2300 | 1000 | 2250 to 3300 | 2400 |
| | 3000 | | | | | | | | | 1500 | 2750 to 3800 | 3400 |

Standard factory set shown. Factory set is at the minimum value of the range indicated. Range indicated is a percentage of setpoint. Percentage indicated is based on the set pressure range in which that setpoint resides. If non-standard sets are required, adherence must be made to constrain shown in above table, including token relief set range and OPSO set range and minimum required difference between token relief and OPSO set.

Gray areas indicate that token relief is not available above 345 mbar setpoint.

1. Minimum token relief values apply -20°C / -4°F service temperatures and above. For service below -20°C / -4°F, add 8 mbar / 0.12 psig to the minimum token relief value listed.

Example: If a non-standard setpoint is needed, see the following example for the proper use of Tables 8a, 8b, 8c and 8d. Non-standard setpoint = 140 mbar / 2 psig, using the value presented above, the factory set of the token relief will be 1.3 x 140 = 182 mbar / 2.6 psig. The factory OPSO and UPSO set pressures are 165% and 50% of the non-standard setpoint, respectively. The resulting settings are: OPSO = 231 mbar / 3.4 psig and UPSO = 70 mbar / 1 psig.

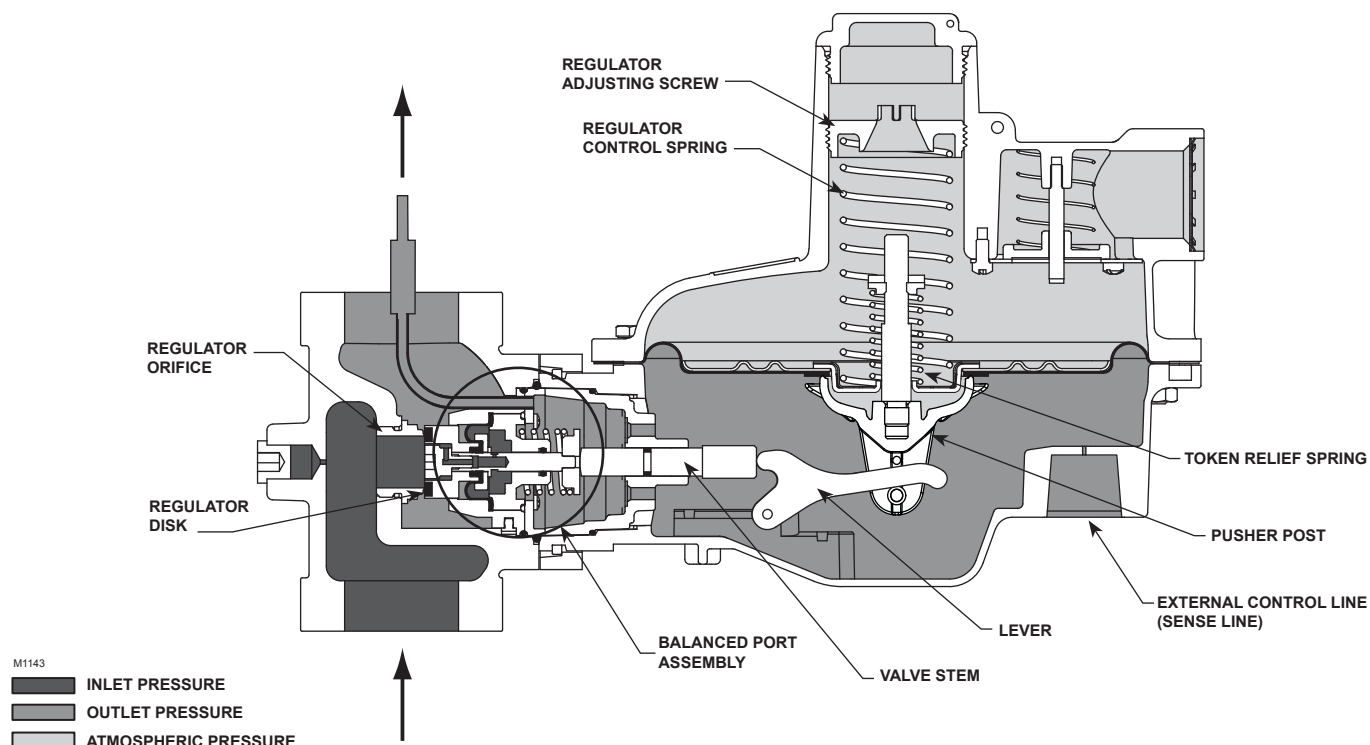


Figure 3. Type CSB400DT Dual Registered Regulator Operational Schematic

Additional overpressure protection options include Types CSB403 and CSB423, which offer True-Monitor™ protection provided by an integral monitor module installed on the inlet side of the valve body. This Integral True-Monitor assumes control of the pressure to the downstream system should the primary regulator fail to regulate. The Types CSB404, CSB424 and CSB454 are examples of CSB400 Series configurations that offer a slam-shut module that shuts off the flow of gas to the downstream system in the event of outlet pressure rising above or falling below the predefined levels due to a failure.

Optional token relief is available, which acts as a low-capacity internal relief valve to relieve minor overpressure situations due to nicks or other minor damage to the orifice or disk, or due to thermal expansion of the downstream system.

Internal, external or dual outlet pressure registration is available. Constructions with dual or external registration require an external control line / sense line. For quick changing loads, dual sense is recommended as it provides the quickest response time.

Principle of Operation

Type CSB400 Base Regulator Operation

Refer to Figure 3. When downstream demand decreases, the pressure under the regulator diaphragm increases. This pressure overcomes the regulator setting (which is set by the regulator control spring). Through the action of the pusher post assembly, lever and valve stem, the valve disk moves closer to the orifice and reduces gas flow. If demand downstream increases, pressure under the regulator diaphragm decreases. Spring force pushes the pusher post assembly downward, the valve disk moves away from the orifice and the gas flow increases downstream as the regulator opens in response to the decreased pressure underneath the regulator diaphragm.

Type numbers with a “T”, for example, Type CSB400IT, provide a token or low-capacity relief. The Token relief provides relief from minor overpressure caused by nicks or dents on the orifice or by thermal expansion of gas in the downstream line. Token relief also provides a token or signal, in the form of odor, that an overpressure situation is occurring.

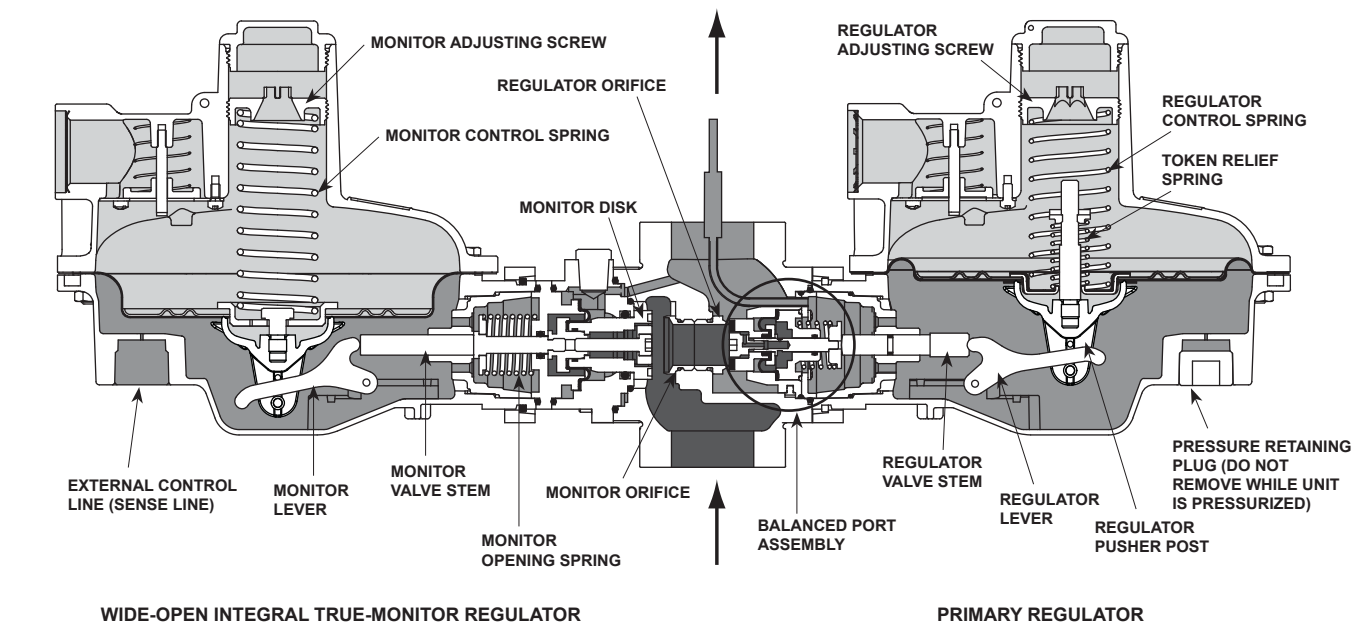


Figure 4. Type CSB403IT Internally Registered Primary Regulator with Externally Registered Integral True-Monitor™ Operational Schematic


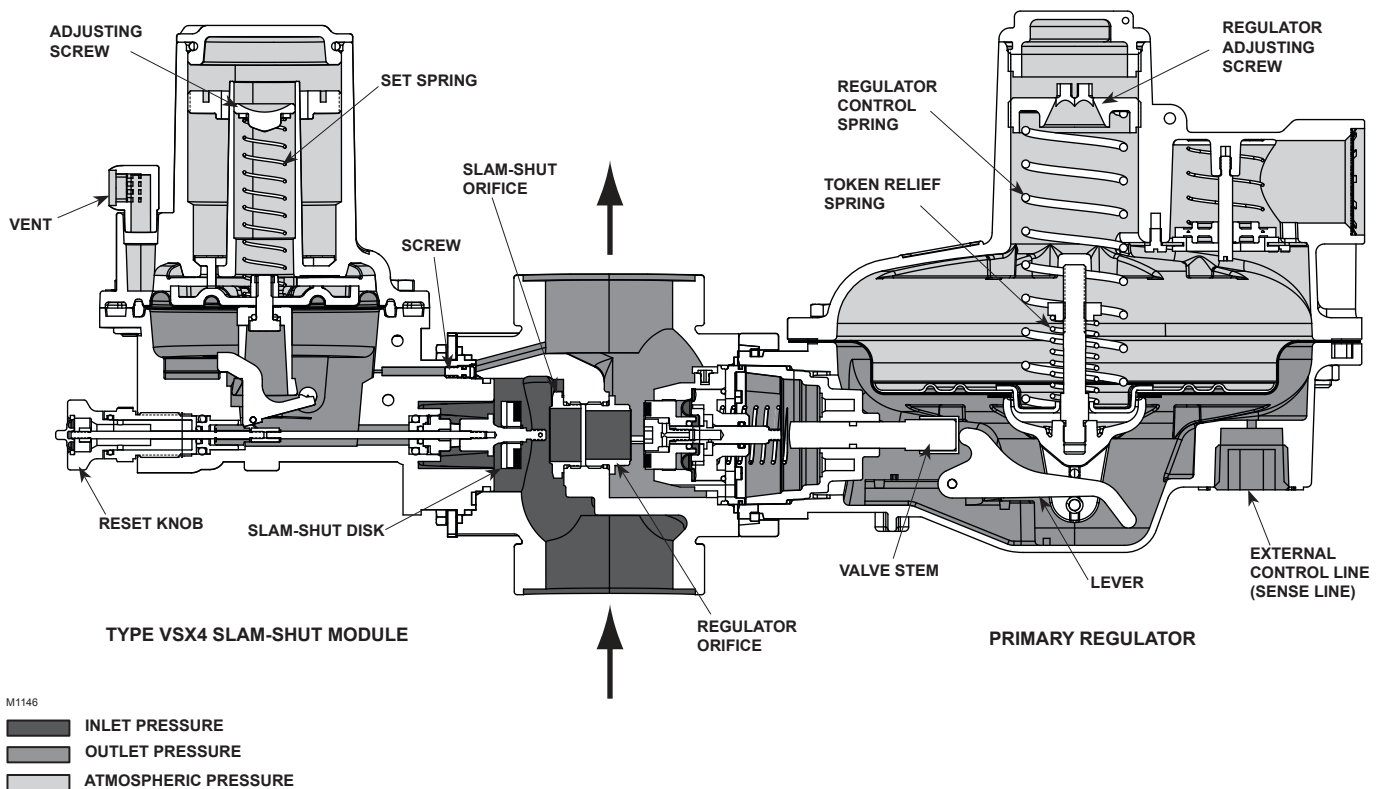


Figure 5. Type CSB404ET Externally Registered Regulator and Slam-shut Operational Schematic

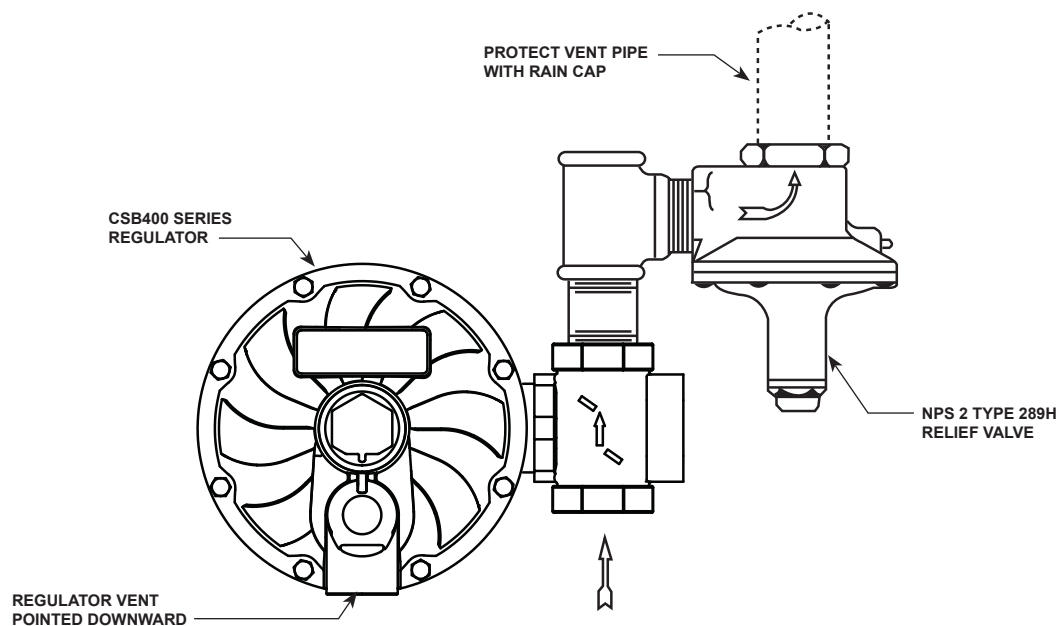

GE27692

Figure 6. CSB400 Series Regulator Installed with the Vent Pointed Downward and with a Type 289H Relief Valve for High Capacity Relief

Type CSB403 Integral True-Monitor™ Operation

Type CSB403 combines the operation of a conventional two-regulator wide-open monitor set into one body, see Figure 4. The Integral True-Monitor is installed on the inlet side of the body and serves to throttle flow and maintain an acceptable downstream pressure in the case where the primary regulator ceases to regulate downstream pressure. During normal operation the Integral True-Monitor is in a wide-open state as its setpoint is set higher than the primary regulator. See Table 7 for guidance regarding the setpoints of the regulator and associated Integral True-Monitor sets. If the downstream pressure should rise to the setpoint of the Internal Monitor due to a loss of pressure control by the primary regulator, the Integral True-Monitor will assume control and regulate the flow to the downstream system. If token relief is present, it will relieve a small amount of gas to the atmosphere as an indication that the Integral True-Monitor is controlling the downstream pressure.

The Type CSB403 provides the option of internal or external downstream pressure registration. External registration requires a downstream sensing line. See Figure 8 for guidance regarding installation of the downstream control line. Refer to the Type TM600 Instruction Manual for additional details of Integral True-Monitor operation.

Type CSB404 Slam-shut Operation

The Type VSX4 slam-shut module on the Type CSB404 regulator is a fast acting shut-off device that provides overpressure (OPSO) or over and underpressure (OPSO / UPSO) protection by completely shutting off the flow of gas to the downstream system. See Table 8 for guidance regarding the typical setpoints of the regulator and associated slam-shut OPSO and also the combined OPSO and UPSO setpoints. The Type VSX4's actions are independent of the Type CSB404 regulator and of variations to the inlet pressure. The Type VSX4 comes standard with external downstream pressure registration, with the option for internal registration only on the Rp 1 x 2-1/4 GAZ body. External registration requires a downstream sensing line. See Figure 9 for guidance regarding installation of the downstream control line.

The Type VSX4 shut-off disk is normally in the open (reset) position, see Figure 5. If the downstream pressure below the slam-shut diaphragm increases (or decreases) until it reaches the slam-shut setpoint, this diaphragm moves upward (or downward) to release the trip mechanism which allows the spring force on the stem to push the disk against the seat, shutting off all gas flow. To reset the slam shut after gas has been shut off, refer to the Types VSX4 and VSX8 Instruction Manual (D103127X012) for additional details.

**WARNING**

In order for the Underpressure Shutoff (UPSO) of any slam shut to be triggered, the downstream pipe pressure must drop below the UPSO setpoint. In the case of a downstream line break, numerous factors can prevent the downstream pipe pressure from decreasing below the slam-shut UPSO setpoint. These factors include the distance of pipe to the break, the diameter of the pipe, size of the break and the number of restrictions, such as valves, elbows and bends, downstream of the regulator and/or slam-shut device. Due to these factors additional protections should be installed to stop flow in the event of a line break.

Installation and Overpressure Protection

Install in accordance with provisions of EN 12186 / EN 12279.

**WARNING**

Personal injury or system damage may result if this regulator is installed, without appropriate overpressure protection, where service conditions could exceed the limits given in the Specifications section and/or regulator nameplate. Regulator and equipment installation should be adequately protected from physical damage.

All vents should be kept open to permit free flow of gas to the atmosphere. Protect openings against entrance of rain, snow, insects or any other foreign material that may plug the vent or vent line. On outdoor installations, point the spring case vent downward to allow condensate to drain, see Figures 6 through 9. This minimizes the possibility of freezing and of water or other foreign materials entering the vent and interfering with proper operation.

For the Type CSB403 with Integral True-Monitor™ or the Type CSB404 with Slam shut, point the vents of both

the primary regulator and Integral True-Monitor or slam shut downward to allow condensate to drain. From the factory, the Integral True-Monitor or slam shut will always point in the same direction as that of the primary regulator.

Under enclosed conditions or indoors, escaping gas may accumulate and be an explosion hazard. In these cases, the vent should be piped away from the regulator to the outdoors.

In case of complete disassembly of the equipment (body included) from the pipeline, care must be taken not to bend, hit or otherwise damage the pitot tube (key 83, Figure 13) that protrudes beyond the body outlet. Damage to the pitot tube could result in inaccurate internal pressure registration and loss of regulation quality.

**CAUTION**

CSB400 Series regulators have an outlet pressure rating lower than their inlet pressure rating. If actual inlet pressure can exceed the outlet pressure rating, outlet overpressure protection is necessary. However, overpressuring any portion of the regulators beyond the limits in the Specifications section may cause leakage, damage to regulator parts or personal injury due to bursting of pressure-containing parts.

Some type of external overpressure protection should be provided to the CSB400 Series if inlet pressure will be high enough to damage downstream equipment. Common methods of external overpressure protection include relief valves, monitoring regulators, shut-off devices and series regulation.

If the regulator is exposed to an overpressure condition, it should be inspected for any damage that may have occurred. Regulator operation below the limits specified in the Specifications section and regulator nameplate does not preclude the possibility of damage from external sources or from debris in the pipeline.

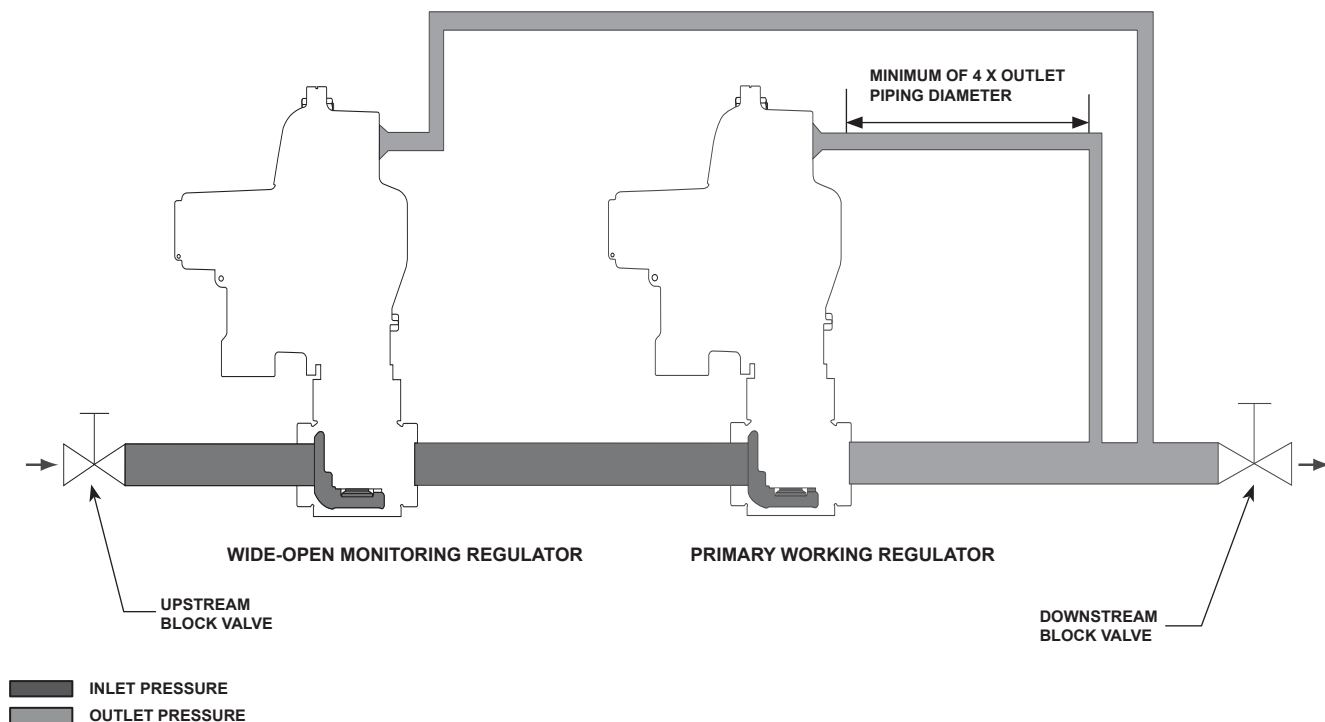


Figure 7. Type CSB400 "Series Monitor" Regulator Downstream Control Line Installation


Before installing the regulator, check for damage which might have occurred in shipment. Also check for dirt or foreign matter which may have accumulated in the regulator body or in the pipeline. Apply pipe compound to the external threads of the pipeline and install the regulator so that flow is in the direction of the arrow cast on the body. The diaphragm casing assembly can be rotated to any position relative to the body. Loosen the two cap screws (key 71, Figure 10) in order to rotate the diaphragm casing assembly.

General Installation Instructions

Before installing the regulator,


- Check for damage, which might have occurred during shipment.
- Check for and remove any dirt or foreign material, which may have accumulated in the regulator body.

- Blow out any debris, dirt or copper sulfate in the copper tubing and the pipeline.
- Apply pipe compound to the external threads of the pipe before installing the regulator.
- Make sure gas flow through the regulator is in the same direction as the arrow on the body. "Inlet" and "Outlet" connections are clearly marked.
- Verify that:
 - Equipment limits of utilization (PS, TS) corresponds to the desired operating conditions.
 - The inlet is protected by an appropriate device(s) to avoid exceeding the allowable limits (PS, TS).
- When designing a pressure reducing station using a Type CSB regulator, make an analysis if it is necessary to take into account the effects of wind, snow and temperature to avoid unnecessary load and movement to the flanges of the equipment.
- If needed, a support may be used under the piping and regulator/slam-shut body to avoid excessive pressure force on the regulator/slam shut.

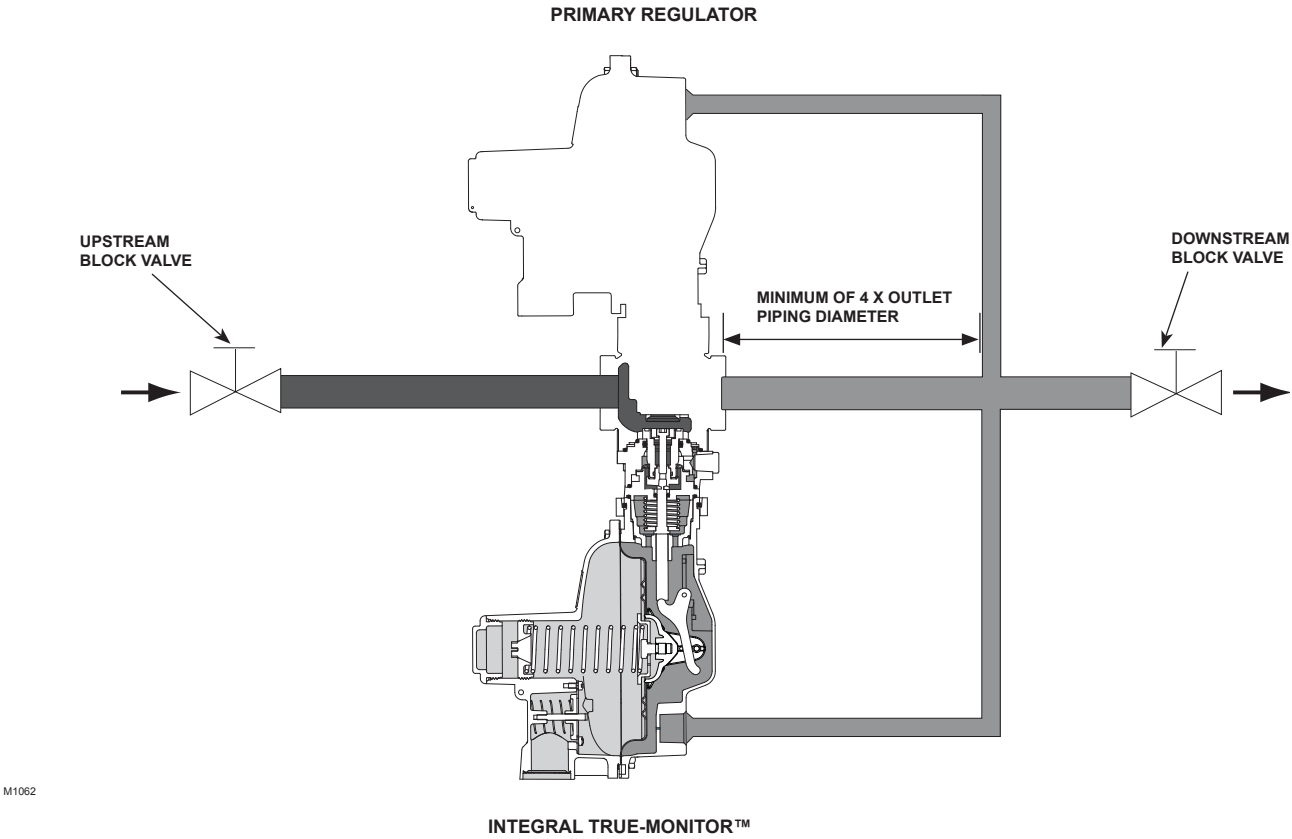

M1062

Figure 8. Type CSB403 Downstream Control Line Installation

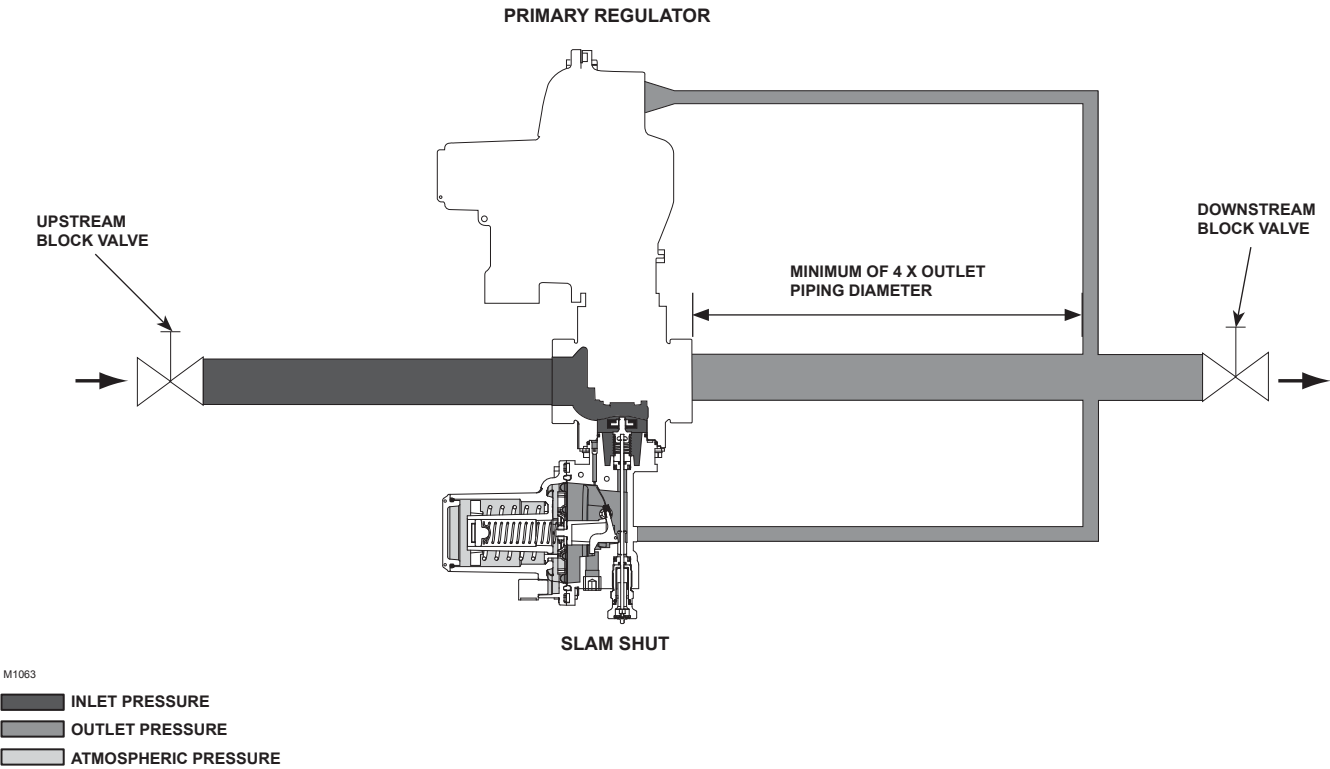

M1063

Figure 9. Type CSB404 Downstream Control Line Installation

Installation Location

- The installed regulator should be adequately protected from vehicular traffic and damage from other external sources.
- Install the regulator with the vent pointed vertically down, see Figures 6 through 9. If the vent cannot be installed in a vertically down position, the regulator must be installed under a separate protective cover. Installing the regulator with the vent down allows condensation to drain, minimizes the entry of water or other debris from entering the vent and minimizes vent blockage from freezing precipitation.
- Do not install the regulator in a location where there can be excessive water accumulation or ice formation, such as directly beneath a downspout, gutter or roof line of building. Even a protective hood may not provide adequate protection in these instances.
- Install the regulator so that any gas discharge through the vent or vent assembly is over 0.91 m / 3 ft. away from any building opening.

Regulators Subjected to Heavy Snow Conditions

Some installations, such as in areas with heavy snowfall, may require a hood or enclosure to protect the regulator from snow load and vent freeze over.

Downstream Control Line Installation



WARNING

Failure to install a downstream control line could result in a hazardous condition. Install downstream control line(s) to the slam-shut device when construction uses external pressure registration.

The regulator and slam-shut device will not control pressure or shutoff if a downstream control line is not installed on those constructions where external pressure registration is required.

CSB400 Series regulators with an “ET” or “EN” in the type number use external pressure registration. To communicate the downstream pressure to the regulator, connect a downstream control line tubing to the 3/4 NPT control line tapping in the lower diaphragm casing and connect the other end of the tubing downstream of the regulator outlet with a minimum distance of 4 times the outlet pipe diameter.

For Types CSB400 and CSB404 with external control lines, use tubing with an outer diameter of 9.5 mm / 0.375 in. or larger. For Types CSB420, CSB424, CSB450 and CSB454 with external control lines, use tubing with an outer diameter of 13 mm / 0.5 in. or larger.

The Types CSB410, CSB414, CSB430 and CSB434 are dedicated wide-open monitoring regulators and are installed upstream of a primary working regulator. Refer to Figure 7 for installation of the downstream control line. To communicate the downstream pressure to the wide-open monitor regulator, connect a downstream control line tubing to the 3/4 NPT control line tapping in the lower diaphragm casing of the monitor regulator and connect the other end of the tubing downstream of the regulator outlet with a minimum distance of 4 times the outlet pipe diameter.

For Types CSB410 and CSB414, use tubing with an outer diameter of 9.5 mm / 0.375 in. or larger.

For Types CSB430 and CSB434, use tubing with an outer diameter of 13 mm / 0.5 in. or larger.

Downstream Control Line Installation with Integral True-Monitor™

Refer to Figure 8. When installing the Types CSB403 and CSB423 regulators, connect downstream control line tubing to the lower casing of the primary regulator, and run the tubing downstream of the regulator outlet with a minimum distance of 4 times the outlet pipe diameter. Connect a second, separate downstream control line tubing to the lower casing of the Integral True-Monitor and run the tubing downstream of the regulator outlet with a minimum distance of 4 times the outlet pipe diameter.

For Type CSB403 with external control lines, use tubing with an outer diameter of 9.5 mm / 0.375 in. or larger for both the primary regulator and Integral True-Monitor.

For Type CSB423 with external control lines, use tubing with an outer diameter of 13 mm / 0.5 in. or larger for both the primary regulator and Integral True-Monitor™.

Downstream Control Line Installation with Slam shut

Refer to Figure 9. When installing the Types CS404ET, CS404EN, CSB424ET, CSB424EN and CSB454EN regulators, connect downstream control line tubing to the lower casing of the regulator and run the tubing downstream of the regulator outlet with a minimum distance of 4 times the outlet pipe diameter. Connect a second, separate downstream control line tubing to the lower casing of the slam shut and run the tubing downstream of the regulator outlet a minimum distance of 4 times the outlet pipe diameter.

For Type CSB404 with external control lines, use tubing with an outer diameter of 9.5 mm / 0.375 in. or larger for the primary regulator and 6.4 mm / 0.25 in. or larger for the slam shut.

For Types CSB424 and CSB454 with external control lines, use tubing with an outer diameter of 13 mm / 0.5 in. or larger for the primary regulator and 6.4 mm / 0.25 in. or larger for the slam shut.

Installation with External Overpressure Protection

If the regulator is used in conjunction with a Type 289H relief valve, it should be installed as shown in Figure 6. The outside end of the vent line should be protected with a rainproof assembly. The Type 289H is typically set 25 mbar / 10 in. w.c. higher than the outlet pressure setting of the regulator, up to 75 mbar / 30 in. w.c. outlet pressure. For pressure greater than this, set the Type 289H 0.05 bar / 0.75 psi higher than the outlet pressure setting of the regulator.

Vent Line Installation

The CSB400 Series regulators have a 1 NPT screened vent opening in the spring case. If necessary to vent escaping gas away from the regulator, install a remote vent line in the spring case tapping. Vent piping should be as short and direct as possible with a minimum number of bends and elbows. The remote vent line should have the largest practical diameter. Vent piping on regulators with token relief must be

large enough to vent all relief valve discharge to atmosphere without excessive backpressure and resulting excessive pressure in the regulator.

For types with optional Token relief, this low capacity relief is located in the spring case of the primary regulator. If necessary to vent escaping gas away, install a remote vent line in the spring case tapping of the primary regulator as described above. Periodically check all vent openings to be sure that they are not plugged or obstructed.

CSB400 Series outlet pressure ranges are shown in Table 6. Outlet pressure higher than 0.34 bar / 5 psig above the setpoint may damage internal parts such as the diaphragm head and valve disk. **The maximum emergency (casing) outlet pressure is 4.0 bar / 58 psig.**

Commissioning



CAUTION

Pressure gauges must always be used to monitor downstream pressure during Startup.

With the downstream system depressurized, use the following procedure to start up the regulator.

1. Check to see that all appliances are turned off.
2. Slowly open the upstream shut-off valve.
3. Check inlet and outlet pressure for correct values.
4. Check all connections for leaks.
5. Turn on utilization equipment and recheck the pressures.

Adjustment

Note

For types that include the Integral True-Monitor module, refer to the Instruction Manual for Type TM600 Integral True-Monitor for adjustment and maintenance of the Integral True-Monitor. For the types that include the slam-shut module, refer to the Instruction Manual for Type VSX4 slam shut for adjustment and maintenance of the slam shut.

CSB400 Series

The range of allowable pressure settings for the primary regulator is stamped on the nameplate. If the required setting is not within this range, substitute the correct spring (as shown in Table 6). If the spring is changed, re-stamp the nameplate to indicate the new pressure range.

A pressure gauge must always be used to monitor downstream pressure while adjustments are being made.

For Types CSB400 and CSB420

1. Remove the closing cap (key 60, Figure 14).
2. To increase the outlet setting, turn the adjusting screw (key 65) clockwise. To decrease the outlet setting, turn the adjusting screw counterclockwise.
3. Replace the closing cap.

For Type CSB450

1. Loosen the hex nut (key 58, Figure 14).
2. To increase the outlet setting, turn the adjusting screw (key 65, Figure 14) clockwise. To decrease the outlet setting, turn the adjusting screw counterclockwise.
3. Tighten the hex nut.

CSB400 Series with Integral True-Monitor™

When adjusting the primary regulator and Integral True-Monitor for operation, ensure that the pressure differences between the primary regulator and the integral monitor shown in Table 7 are observed. For example, if the primary regulator setpoint is set at 20 mbar / 8 in. w.c., then the Integral True-Monitor should be set at a minimum of 35 mbar / 14 in. w.c. or higher.

To test the Integral True-Monitor operation, the primary regulator setpoint must be adjusted above the Integral True-Monitor's setpoint to simulate a failure of the primary regulator. If the spring range of the primary regulator is sufficiently high, it can simply be adjusted above the Integral True-Monitor's setpoint by following step 2 above. Otherwise, a different spring

with a setpoint higher than the Integral True-Monitor's setpoint must be installed to check the operation of the Integral True-Monitor.

CSB400 Series with Slam shut

When adjusting the primary regulator and slam shut for operation, refer to Table 8 for the OPSO setpoints and also the combined OPSO and UPSO setpoints of the slam shut for a given regulator spring ranges. Reference Type VSX4/VSX8 Instruction Manual (D103127X012) for steps to properly maintain the Slam-shut module.



CAUTION

Equipment installed downstream the Type VSX slam shut device can be damaged if the following procedure for resetting the Type VSX slam shut device is not followed. This equipment includes the integral Type VSX or regulator configurations.

Step 1:


- Slowly pull the reset button (refer to Type VSX4 Instruction Manual, key 30) away from the Type VSX device. This slow movement allows for a slow bleed of the pressure across the Type VSX slam shut's disk and seat area. The operator should be able to hear the pressure bleeding through the system.

Step 2:

- When the pressure has equalized and the air bleeding sound has dissipated, the reset button (refer to Type VSX4 Instruction Manual, key 30) should be pulled completely away from the Type VSX slam shut device by hand until the internal shut-off mechanism has been re-latched.

Step 3:

- Once the operator feels the click of the re-latch occurring, the reset button (refer to Type VSX4 Instruction Manual, key 30) should be pushed completely back into its original position.

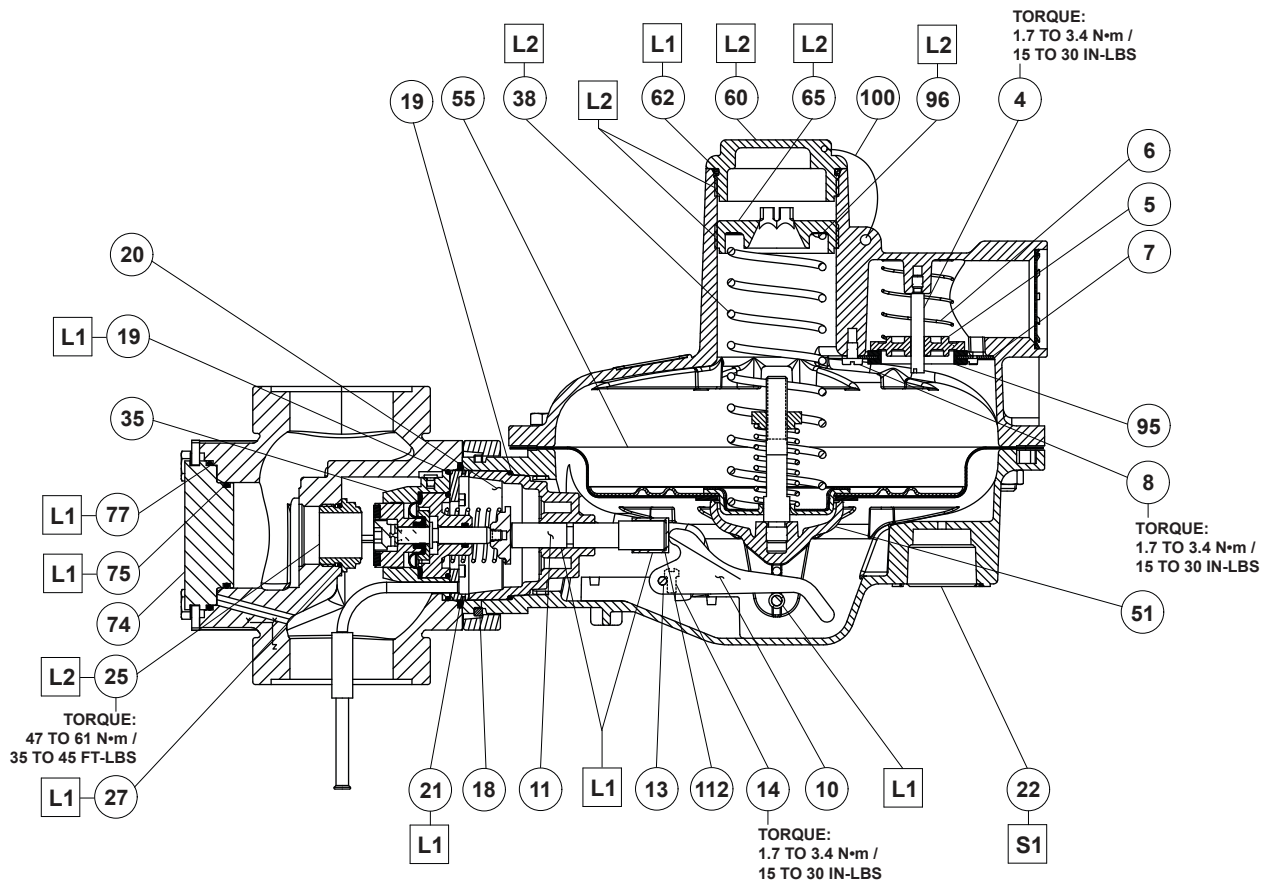

ERAA04154

□ APPLY LUBRICANTS (L) / SEALANT (S)⁽¹⁾:

L1 = DOW CORNING® 33 OR COMPARABLE EXTREME LOW TEMPERATURE LUBRICANT

L2 = ANTI-SEIZE LUBRICANT

S1 = MULTI-PURPOSE POLYTETRAFLUOROETHYLENE (PTFE) THREAD SEALANT

1. Lubricants and sealant must be selected such that they meet the temperature requirements.

Figure 10. CSB400 Series Regulator Assembly


WARNING

In the case of a downstream line break, numerous factors affect the capability to evacuate gas from the pipeline. These factors include the distance of pipe to the break, the diameter of the pipe, size of the break and the number of restrictions, such as valves, elbows and bends, downstream of the regulator and/or slam-shut device. Due to these factors additional protections should be installed to stop flow in the event of a line break.

Shutdown

Installation arrangements may vary, but in any installation it is important that the valves be opened or closed slowly and that the outlet pressure be vented before venting inlet pressure to prevent damage caused by reverse pressurization of the regulator. The following steps apply to the typical installation as indicated.

1. Open valves downstream of the regulator.
2. Slowly close the upstream shut-off valve.
3. Inlet pressure should automatically be released downstream as the regulator opens in response to the lowered pressure underside of the diaphragm.
4. Close outlet shut-off valve.

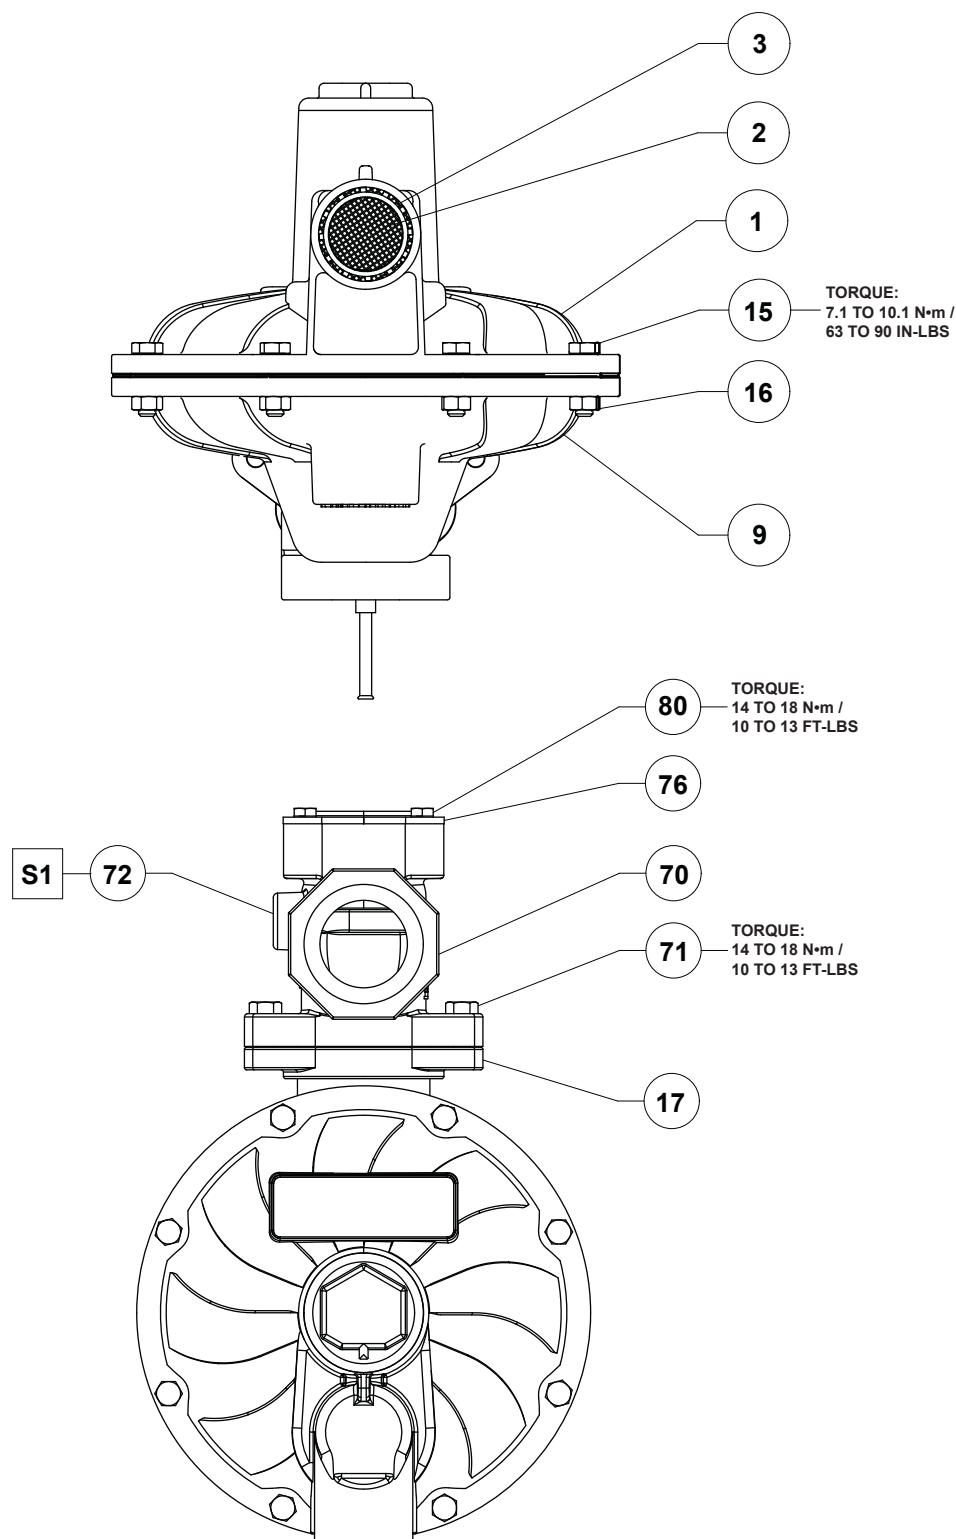

ERAA04154

☐ **APPLY SEALANT (S)⁽¹⁾:**

S1 = MULTI-PURPOSE PTFE THREAD SEALANT

1. Sealant must be selected such that it meets the temperature requirements.
2. The torque range as specified is initial assembly torque. Due to elastomeric compression, the torque values indicated may decrease. Minimum inspection torque is 4 N•m / 35 in-lbs.

Figure 10. CSB400 Series Regulator Assembly (continued)

Maintenance and Inspection



WARNING

To avoid personal injury or equipment damage, do not attempt any maintenance or disassembly without first isolating the regulator from system pressure and relieving all internal pressure as described in “Shutdown”.

Regulators that have been disassembled for repair must be tested for proper operation before being returned to service. Only parts manufactured by Emerson should be used for repairing Fisher™ regulators. Restart gas utilization equipment according to normal startup procedures.

Due to normal wear or damage that may occur from external sources, this regulator should be inspected and maintained periodically. The frequency of inspection and replacement depends on the severity of service conditions, test results found during the annual test and on applicable codes and regulations. In accordance with applicable National or Industry codes, standards and regulations/recommendations, all hazards covered by specific tests after final assembly, before applying the CE marking, shall also be covered after every subsequent reassembly at installation site in order to ensure that the equipment will be safe throughout its intended life.

Periodic inspection must be performed on the CSB400 Series that include the Integral True-Monitor™ or slam-shut overpressure protection modules to ensure that they protect the downstream system in the event the primary regulator loses pressure control. This inspection must test that the Integral True-Monitor or slam-shut functions as intended.



WARNING

Only parts manufactured by Emerson should be used for repairing and/or replacement purposes.

Note

For adjusting setpoints above 100 mbar / 1.5 psig, use a 13 mm / 1/2 in. hex driver, a 13 mm / 1/2 in. socket or a 27 mm / 1-1/16 in. socket to turn the adjusting screw (key 65).

Disassembly to Replace the Regulator Main Diaphragm

1. Remove the closing cap (key 60, Figure 10) or loosen hex locknut (key 58, Figure 14). Turn the adjusting screw (key 65) or nut (key 58) counterclockwise to ease spring (key 38) compression.
2. Remove the adjusting screw (key 65) and spring (key 38).
3. Remove hex nuts (key 16, Figure 10) and cap screws (key 15, Figure 10). Separate the upper spring case (key 1) from the lower casing assembly (key 9).

Note

When disassembling a CSB400 Series regulator, lift the upper spring case (key 1) straight up in order to avoid hitting the stem (key 44).

4. Slide the diaphragm assembly (key 55) away from the body (key 70) to unhook the pusher post (key 51) from the lever (key 10). Lift off the diaphragm assembly (key 55).
5. a. For none relieving units such as the Types CSB400IN and CSB400EN, unscrew the cap (key 45), see Figure 11, high-pressure Non-Relief and low-pressure Non-Relief assemblies. The cap fastens the R.V. spring seat (key 43) to the pusher post (key 51). Unscrew the cap to separate the R.V. spring seat (key 43), diaphragm assembly (key 55) and pusher post (key 51).
- b. For units with internal token relief such as Type CSB400IT, refer to Figure 11, unscrew the adjusting upper seat (key 47). This will allow for removal of the relief spring (key 41), R.V. spring seat (key 43), diaphragm assembly (key 55) and pusher post (key 51).

6. Reassemble the spring case (key 1) unit in the reverse order of the above steps. Before tightening the cap screws (key 15) or stem (key 44) into the pusher post (key 51), place the loosely-assembled diaphragm assembly (key 55) into position in the lower casing (key 9), being sure that the pusher post (key 51) is hooked on the lever (key 10). Rotate the diaphragm (key 55A) so that the diaphragm and lower casing (key 9) holes are aligned. Tighten the stem (key 44) or diaphragm retainer (key 45) for HP and LP non-relief assemblies.

Disassembly to Replace Valve Disk, Balanced Port Assembly Diaphragm and Regulator Orifice

1. Remove the bolts (key 71, Figure 10) which hold the lower spring casing (key 9) to the body (key 70). Separate the lower spring casing (key 9) from the body (key 70).
2. Check the body O-ring (key 21) for wear.
3. Remove the balanced port assembly (key 35, Figures 10 and 12) from the body, make sure to rotate the assembly toward the outlet of the body as it is being removed to clear the sense tube from the body.
4. Examine the valve disk (key 35K) for nicks, cuts and other damage. If damage is present, it is recommended to replace both the disk and also the balanced port diaphragm (key 35F) and associated diaphragm O-ring (key 35M), that comes into direct contact with the inner flange of the balanced port diaphragm. Start the process of replacing the disk by disassembling the balanced port assembly. Remove the four cap screws (key 35R) and then the cap (key 35G).
5. Grasp the spring retainer (key 35C) and slide the brazed housing (key 35A) away to expose the diaphragm (key 35F) and disk (key 35K). Still grasping the spring retainer (key 35C) insert a 5 mm / 0.2 in. Allen wrench into the disk screw (key 35E) and unscrew.
6. Remove the disk (key 35K) and discard if damaged. Slide the diaphragm O-ring (key 35M) off the stem (key 35B) along with the diaphragm (key 35F). Slide the new diaphragm over the stem in the same manner that it was removed, make sure that it completely contacts the surface of the inner retainer (key 35J).
7. Reassemble the Balanced Port assembly in reverse order of the above. Ensure Dow Corning® 33 or comparable extreme low temperature lubricant completely coats the O-ring (key 35M), stem (key 35B) and the center bore of the outer retainer (key 35H).
8. Examine the seating edge of the orifice (key 25). If it is nicked or rough, replace the orifice and O-ring (key 27). If a slam shut or monitor is installed on the backside of the body, refer to the applicable Instruction Manual for inspection and removal of the overpressure protection orifice (key 26) and O-ring (key 27).
9. Reassemble the regulator in reverse order of the above steps.

Regulator Reassembly

As indicated by the square callouts in Figures 10 to 15, it is recommended that a good quality pipe thread sealant be applied to pressure connections and fittings and a good quality extreme low temperature lubricant, such as Dow Corning® 33, be applied to O-rings. Also apply an anti-seize compound to the adjusting screw threads orifice threads and other noted areas as needed.

Parts Ordering

The type number, orifice size, spring range and date of manufacture are stamped on the nameplate. Always provide this information in any correspondence with your local Sales Office regarding replacement parts or technical assistance.

When ordering replacement parts, reference the key number of each needed part as found in the following parts list. Separate kit containing all recommended spare parts is available.


Parts List

| Key | Description | Part Number | Key | Description | Part Number |
|-----|--|-------------|------|---|-------------|
| | Spare Parts (Repair Parts Kit include keys 12, 19, 21, 27, 35K, 55, 62, 75 and 77) | | | | |
| | Type CSB400 | RCSB400X012 | 35A | Brazed Housing, Zinc-plated steel | GE31261X012 |
| | Type CSB403 | RCSB403X012 | 35B | Stem, Stainless steel | ERAA15222A0 |
| | Type CSB404 | RCSB404X012 | 35C | Spring Retainer, Zinc-plated steel | GE31189X012 |
| 1 | Spring Case, Aluminum | GE24555X012 | 35D | Spring, Stainless steel | ERAA15508A0 |
| 2 | Vent Screen, 18-8 Stainless steel | T1121338982 | 35E | Disk Screw, Zinc-plated steel | GE31190X012 |
| 3 | Retaining Ring, Steel | T1120925072 | 35F* | Diaphragm, Nitrile (NBR) / Fabric | ERRA15224A0 |
| 4 | Stabilizer Guide, 304 Stainless steel | GE27061X012 | 35G | Cap, Brass | GE31195X012 |
| 5 | Stabilizer, Acrylonitrile Butadiene Styrene (ABS) | GE27063X012 | 35H | Outer Retainer, Brass | GE31187X012 |
| 6 | Stabilizer Spring, Stainless steel | GE35010X012 | 35J | Inner Retainer, Zinc-plated steel | ERAA16571A0 |
| 7 | Retainer Ring, Zinc-plated steel | GE27024X012 | 35K* | Disk Assembly, Brass / Nitrile (NBR) | |
| 8 | Stabilizer Screw, Zinc-plated steel (3 required) | GE29724X012 | | Standard version | ERSA00457A0 |
| 9 | Lower Casing, Aluminum | GE24289X012 | | Low Temperature "F" version | GE31185X012 |
| 10 | Lever, Steel | | 35M | O-ring, Nitrile (NBR) (2 required) | ERAA17405A0 |
| | Types CSB400, CSB403, CSB404, CSB410 and CSB414 | GE28773X012 | 35N* | O-ring, Nitrile (NBR) | 1U879006562 |
| | Types CSB420, CSB423, CSB424, CSB430, CSB434, CSB450 and CSB454 | GE28772X012 | 35R | Screw, Steel (4 required) | GE25968X012 |
| 11 | Valve Stem, Aluminum | GE27812X012 | 35S | Pin, Zinc-plated steel | GE31232X012 |
| 12* | O-ring, Nitrile (NBR) | | 35U | Thrust Washer, Stainless steel | ERAA16573A0 |
| | External Registration Only | 1E472706992 | 35 | Balanced Port Assembly for Rp 1 x 2-1/4 in. | |
| 13 | Lever Pin, 18-8 Stainless steel | | | GAZ in Internal or Dual Registration | |
| | Types CSB400, CSB403, CSB404, CSB410 and CSB414 | T14397T0012 | | Standard temperature, -20 to 66°C / -4 to 150°F | GE33822X012 |
| | Types CSB420, CSB423, CSB424, CSB430, CSB434, CSB450 and CSB454 (2 required) | T14397T0012 | | Low temperature, -30 to 66°C / -22 to 150°F | |
| 14 | Lever Screw, Steel | | | "F" version | GE33822X022 |
| | Types CSB400, CSB403, CSB404, CSB410 and CSB414 (2 required) | GE34243X012 | 35A | Brazed Housing, Zinc-plated steel | GE32505X012 |
| | Types CSB420, CSB423, CSB424, CSB430, CSB434, CSB450 and CSB454 (4 required) | GE34243X012 | 35B | Stem, Stainless steel | ERAA15222A0 |
| 15 | Cap Screw, Steel (8 required) | GE32059X012 | 35C | Spring Retainer, Zinc-plated steel | GE31189X012 |
| 16 | Nut, Steel (8 required) | GE32060X012 | 35D | Spring, Stainless steel | ERAA15508A0 |
| 17 | Union Ring, Aluminum | GE26590X012 | 35E | Disk Screw, Zinc-plated steel | GE31190X012 |
| 18 | Snap Ring, 302 Stainless steel | T1120637022 | 35F* | Diaphragm, Nitrile (NBR) / Fabric | ERRA15224A0 |
| 19* | O-ring, Nitrile (NBR) (2 required) | 1K594906562 | 35G | Cap, Brass | GE31195X012 |
| 20 | Stem Guide, Aluminum | GE26027X012 | 35H | Outer Retainer, Brass | GE31187X012 |
| 21* | O-ring, Nitrile (NBR) | GE45216X012 | 35J | Inner Retainer, Zinc-plated steel | ERAA16571A0 |
| 22 | Pipe plug, 3/4 NPT, Steel | | 35K* | Disk Assembly, Brass / Nitrile (NBR) | |
| | Internal Registration Only | GE34199X012 | | Standard version | ERSA00457A0 |
| 23 | Screw (For external registration only), Steel (2 required) | 1E175828982 | | Low-temperature "F" version | GE31185X012 |
| 24* | O-ring (For external registration only), Nitrile (NBR) (2 required) | 17A0960X012 | 35M | O-ring, Nitrile (NBR) (2 required) | ERAA17405A0 |
| 25 | Orifice | | 35N* | O-ring, Nitrile (NBR) | 1U879006562 |
| | Types CSB400F and CSB404F, Aluminum | GG08494X012 | 35R | Screw, Cap, Hex Socket, Steel (4 required) | GE25968X012 |
| | All other types, Brass | GE31321X012 | 35U | Thrust Washer, Stainless steel | ERAA16573A0 |
| 26 | OPP Orifice 18 mm / 0.69 in. | | 35 | Balanced Port Assembly for All External | |
| | With Integral True-Monitor™ Orifice, Aluminum | GE30003X012 | | Registration Bodies except GAZ body | |
| | With Slam-shut Orifice, Brass | GE28684X012 | | Standard, -20 to 66°C / -4 to 150°F | ERAA14234A0 |
| 27* | O-ring, Nitrile (NBR) | | | Low Temperature, -30 to 66°C / -22 to 150°F | |
| | Type CSB400 (1 required) | 10A3802X022 | | "F" version | ERAA14234A1 |
| | Type CSB403 (2 required) | 10A3802X022 | 35A | Brazed Housing, Zinc-plated steel | ERAA14098A0 |
| | Type CSB404 (2 required) | 10A3802X022 | 35B | Stem, Stainless steel | ERAA15222A0 |
| 35 | Balanced Port Assembly for | | 35C | Spring Retainer, Zinc-plated steel | GE31189X012 |
| | All Internal and Dual Registration Bodies | | 35D | Spring, Stainless steel | ERAA15508A0 |
| | Standard, -20 to 66°C / -4 to 150°F | GE31196X012 | 35E | Disk Screw, Zinc-plated steel | GE31190X012 |
| | Low temperature, -30 to 66°C / -22 to 150°F | | 35F | Diaphragm | ERAA15224A0 |
| | "F" version | GE31196X022 | 35G | Cap, Brass | GE31195X012 |
| | | | 35H | Outer Retainer, Brass | GE31187X012 |
| | | | 35J | Inner Retainer, Carbon steel | ERAA16571A0 |
| | | | 35K | Disk Assembly, Brass / Nitrile (NBR) | |
| | | | | Standard | ERSA00457A0 |
| | | | | Low Temperature "F" version | GE31185X012 |
| | | | 35M | O-ring, Nitrile (NBR) (2 required) | ERAA17405A0 |
| | | | 35N | O-ring, Nitrile (NBR) | 1U879006562 |
| | | | 35R | Screw, Steel (4 required) | GE25968X012 |
| | | | 35S | Pin, Carbon steel | GE31232X012 |
| | | | 35U | Thrust Washer, Stainless steel | ERAA16573A0 |

*Recommended spare part.

CSB400 Series

| Key | Description | Part Number | Key | Description | Part Number |
|-----|---|---|-----|--|---|
| 38 | Spring 17 to 24 mbar / 6.8 to 9.6 in. w.c., Pink 24 to 35 mbar / 9.6 to 14 in. w.c., Orange Stripe 35 to 60 mbar / 14 to 24 in. w.c., Dark Green 54 to 100 mbar / 0.78 to 1.5 psig, Tan 100 to 160 mbar / 1.45 to 2.3 psig, Purple Stripe 138 to 300 mbar / 2.0 to 4.4 psig, Dark Blue 276 to 517 mbar / 4 to 7.5 psig, Red 500 mbar to 1 bar / 7.3 to 14.5 psig, Light Blue 1 to 3 bar / 14.5 to 43.5 psig, Light Green | GE30191X012 GE43955X012 GE30201X012 GE30202X012 GE35081X012 GE30192X012 GE33121X012 GE30203X012 GE30204X012 | 70 | Body Ductile Cast Iron NPT: 1 1-1/4 1-1/2 2 Rp: Rp 1 Rp 1-1/4 Rp 1-1/2 Rp 1 x 1-1/4 Rp 1 x 2-1/4, GAZ Rp 2 Flange: DN 50 / NPS 2, CL150 FF DN 40 / NPS 1-1/2, PN 10/16 Slip-Flange DN 50 / NPS 2, PN 10/16 WCC Steel NPT: 1 1-1/4 1-1/2 Rp: Rp 1 Rp 1-1/4 Rp 1-1/2 | GE26463X012 GE26465X012 GE26466X012 GE26467X012 GE26468X012 GE26469X012 GE26470X012 GE42505X012 GE26482X012 GE26471X012 GE26480X012 GE44902X012 GE26481X012 |
| 40 | Upper Spring Seat, Steel High Pressure, Zinc-plated steel | GE32501X012 | | | |
| 41 | Relief Valve Spring, 302 Stainless steel Types CSB400, CSB403 and CSB404, Token Types CSB420, CSB423 and CSB424, Token | GE30194X012 GE42225X012 | | | |
| 43 | Relief Valve Spring Seat, Zinc-plated steel Types CSB400 and CSB420, Non-Relief Type CSB450, Non-Relief Types CSB400 and CSB420, Token | GE27327X012 GE31677X012 GE28947X012 | | | |
| 44 | Stem, Aluminum Types CSB400 and CSB420, Token | GE30895X012 | | | |
| 45 | Diaphragm Retainer, Zinc-plated steel Types CSB400 and CSB420, Non-Relief Type CSB450, Non-Relief | GE30887X012 GE33850X012 | | | GE26463X022 GE26465X022 GE26466X022 |
| 47 | Upper Spring Seat, Aluminum Types CSB400 and CSB420, Token | GE33332X012 | | | GE26468X022 GE26469X022 GE26470X022 |
| 48 | Restrictor Plate, Zinc-plated steel Token | GE28948X012 | | | GE32061X012 |
| 51 | Pusher Post, Aluminum Token Non-Relief | ERAA00876A0 ERAA00875A0 | 71 | Bolt, Steel (2 required) | |
| 53 | Solid Rivet, 18-8 Stainless steel | GE29761X012 | 72 | Pipe Plug, 1/4 NPT Steel 316 Stainless steel | 1C333528992 1C3335X0012 |
| 54 | Roller Pin, Brass | GE27060X012 | 74 | Blanking Plug, Aluminum | GE31255X012 |
| 55* | Diaphragm Assembly, Steel / Nitrile (NBR) Without Diaphragm Head Limiter With Diaphragm Head Limiter | GE31248X012 GE32140X012 | 75* | O-ring, Metric, Nitrile (NBR) | GF03442X012 |
| 55A | Diaphragm | ----- | 76 | Half Flange, Steel (2 required) | GF01942X012 |
| 55B | Diaphragm Head | ----- | 77* | Metric O-ring, Nitrile (NBR) | GF03443X012 |
| 56 | Retaining Ring, Pusher Post Pin | GE33772X012 | 80 | Cap Screw, Steel (4 required) | GE38176X012 |
| 57 | Bearing ball | GE33131X012 | 81 | Slotted Spring Pin | GE32503X012 |
| 58 | Hex Nut, High-Pressure, (CSB450 Series only) Steel | GE33132X012 | 82 | Tube Gasket, Nitrile (NBR) | GE32502X012 |
| 60 | Closing Cap, Low-Pressure, Aluminum | GE29244X012 | 83 | Pitot Tube, Aluminum | GE31988X012 |
| 61 | Bonnet, High-Pressure, (CSB450 Series only) Zinc-plated steel | GE32499X012 | 90 | Nameplate | ----- |
| 62* | O-ring, Nitrile (NBR) | T10275X0012 | 91 | Warning Label | ----- |
| 65 | Adjust Screw Low-Pressure, Aluminum High-Pressure, Steel | GE27828X012 GE32500X012 | 93 | Information Label | ----- |
| | | | 94 | Overlay Label | ----- |
| | | | 95 | Grommet, Nitrile (NBR) | GE35358X012 |
| | | | 96 | Slip Disk, Stainless steel | GG05787X012 |
| | | | 100 | Wire and Seal | T14088T0012 |
| | | | 101 | Spring Pin, Steel | GE32724X012 |
| | | | 104 | Hub, Zinc-plated steel (2 required) not shown | GG02505X012 |
| | | | 105 | Flange Slip, Zinc-plated steel (2 required) not shown | GG02508X012 |
| | | | 106 | O-ring, Nitrile (NBR) (2 required) not shown | GE41121X012 |
| | | | 107 | Diaphragm Head Limiter, Zinc-plated steel | GE28761X012 |
| | | | 108 | Diaphragm Protector, Zinc-plated steel | GE42747X012 |
| | | | 109 | Pad, (CSB450 Series only) | T13830T0012 |
| | | | 112 | Stem Cap | ERAA16569A0 |

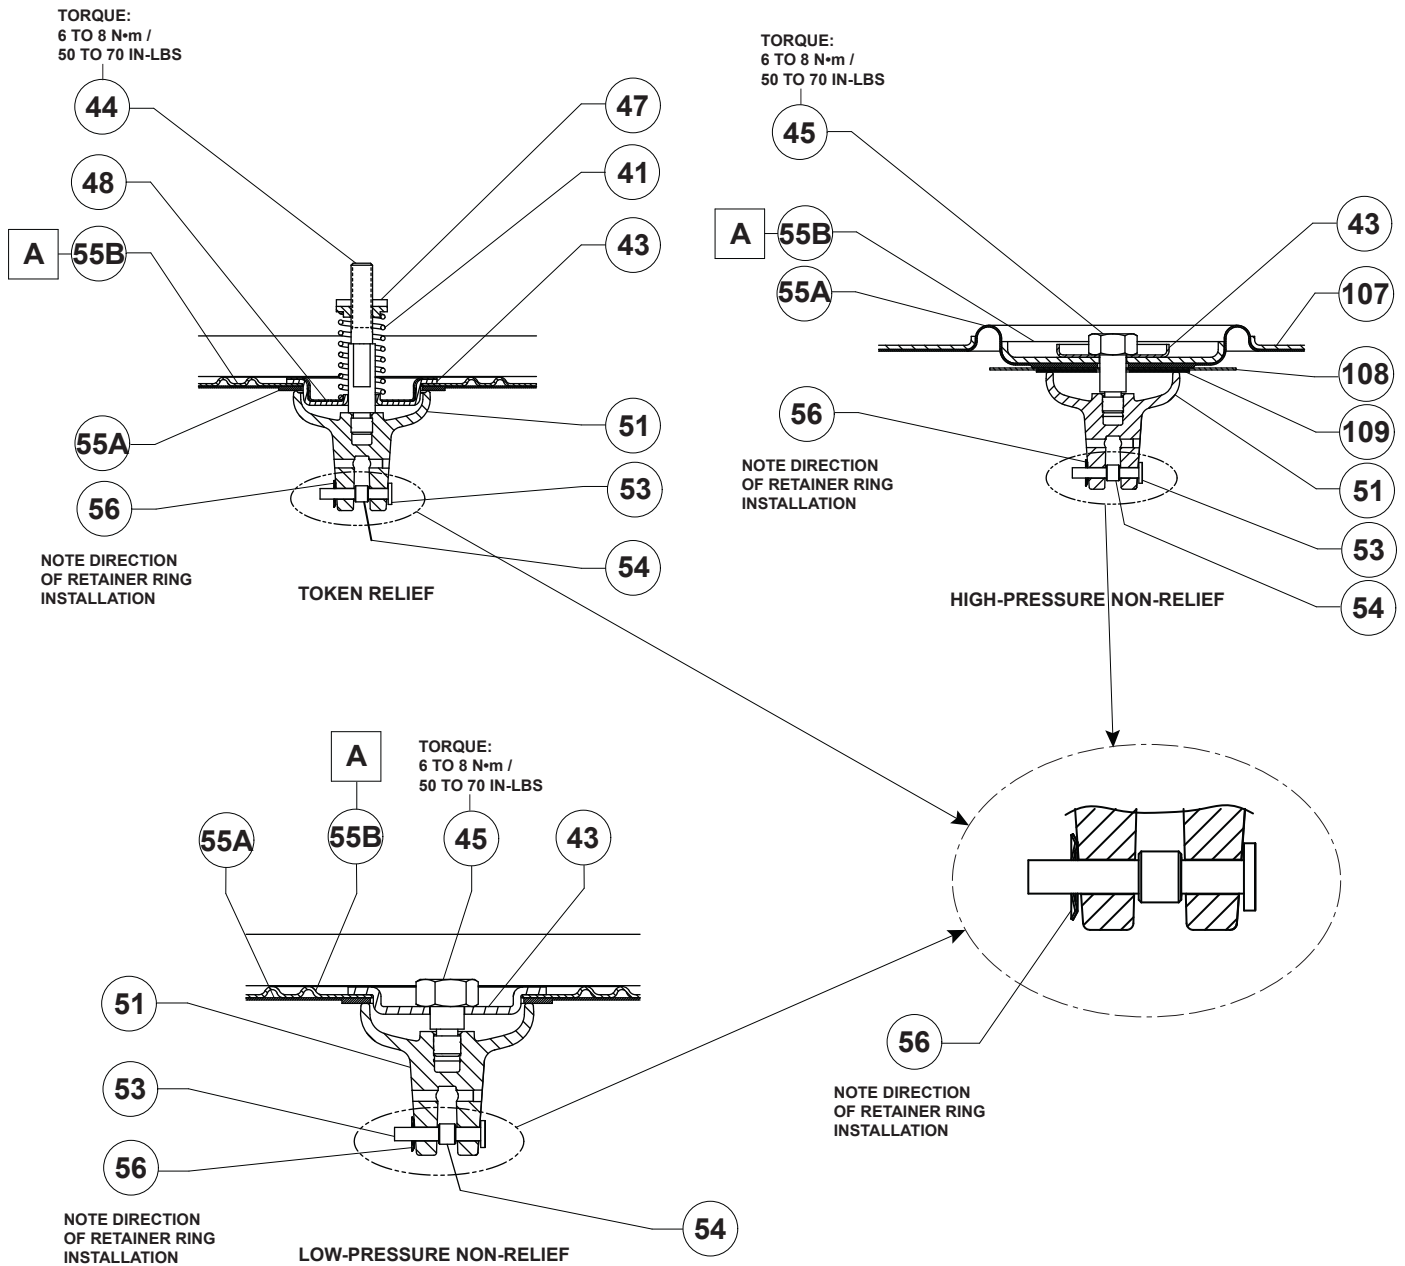


ERAA04154

☐ APPLY ADHESIVE (A)⁽¹⁾:
A = ADHESIVE

NOTE: APPLY ADHESIVE ON THE FLAT SURFACE OF THE DIAPHRAGM PLATE THAT CONTACTS THE DIAPHRAGM, TOWARD THE OUTER PERIMETER, AND AWAY FROM THE CENTER HOLE.

1. Adhesive must be selected such that it meets the temperature requirements.

Figure 11. CSB400 Series Diaphragm and Relief Assemblies

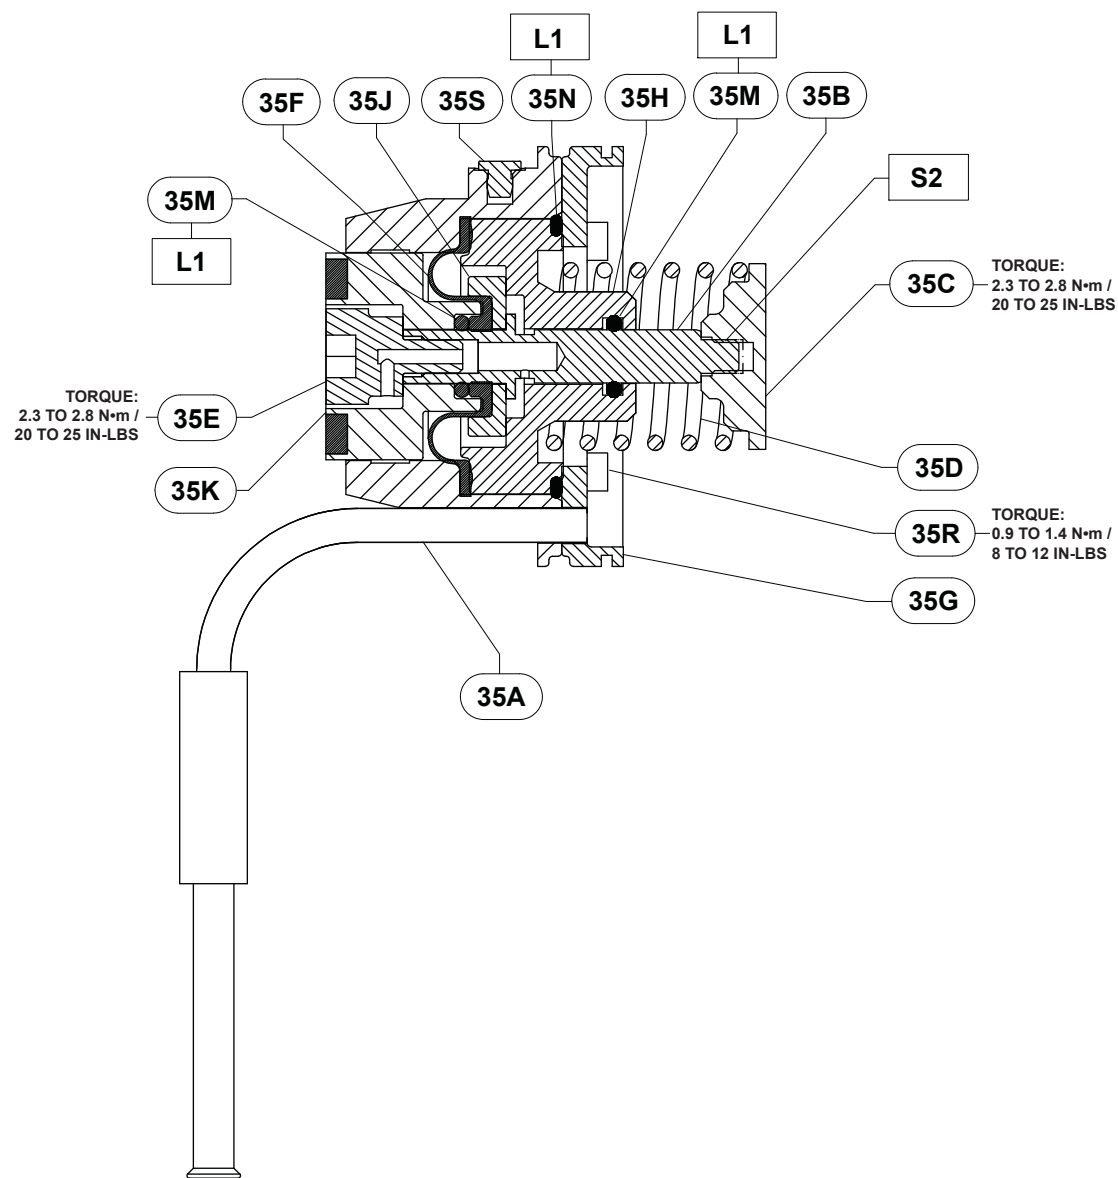

STANDARD BALANCED PORT ASSEMBLY - INTERNAL REGISTRATION


ERAA04154

☐ APPLY LUBRICANT (L) / SEALANT (S)⁽¹⁾:
L1 = DOW CORNING® 33 OR COMPARABLE EXTREME LOW TEMPERATURE LUBRICANT
S2 = PERMANENT THREAD SEALANT


1. Lubricant and sealant must be selected such that they meet the temperature requirements.

Figure 12. Balance Trim Assemblies

Dow Corning® is a mark owned by Dow Corning Corporation.

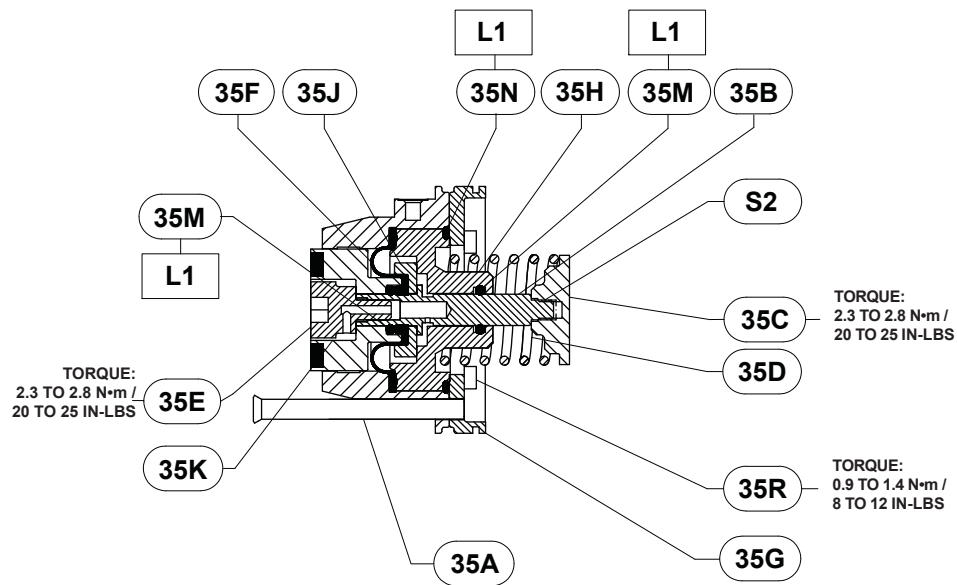

BALANCED PORT ASSEMBLY FOR Rp 1 X 2-1/4 GAZ BODY - INTERNAL REGISTRATION

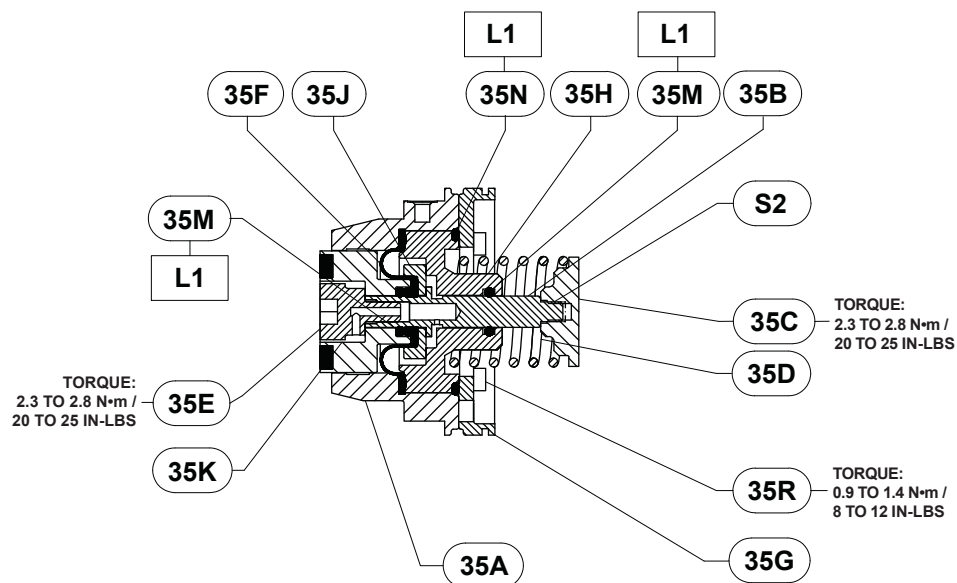

BALANCED PORT ASSEMBLY FOR RP 1 X 2-1/4 GAZ BODY - EXTERNAL REGISTRATION

ERAA04154

□ APPLY LUBRICANT (L) / SEALANT (S)⁽¹⁾:
L1 = DOW CORNING® 33 OR COMPARABLE EXTREME LOW TEMPERATURE LUBRICANT
S2 = PERMANENT THREAD SEALANT

1. Lubricant and sealant must be selected such that they meet the temperature requirements.

Figure 12. Balance Trim Assemblies (continued)

CSB400 Series

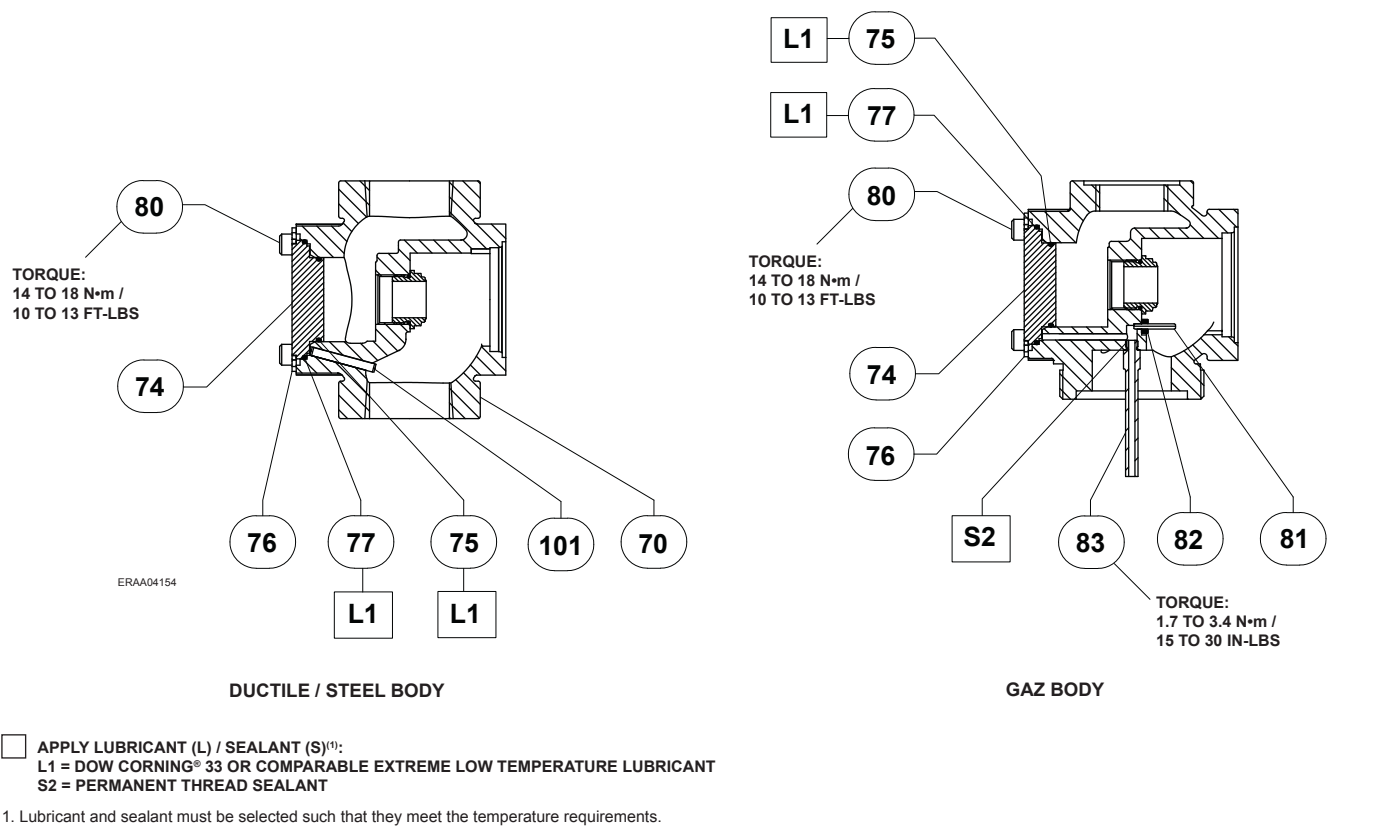


Figure 13. Standard Body Assembly and Rp 1 x 2-1/4 GAZ Body Assembly



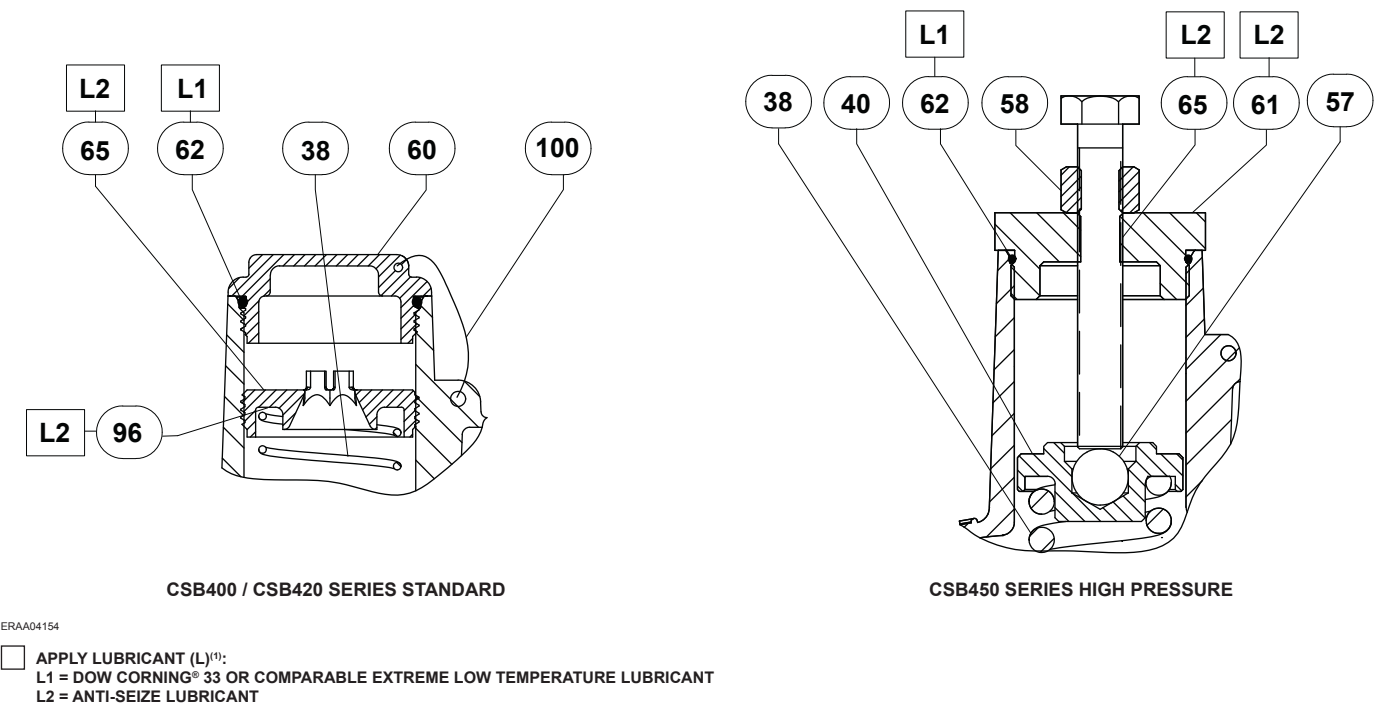


Figure 14. CSB400 Series Control Spring Adjustment Assemblies

Dow Corning® is a mark owned by Dow Corning Corporation.

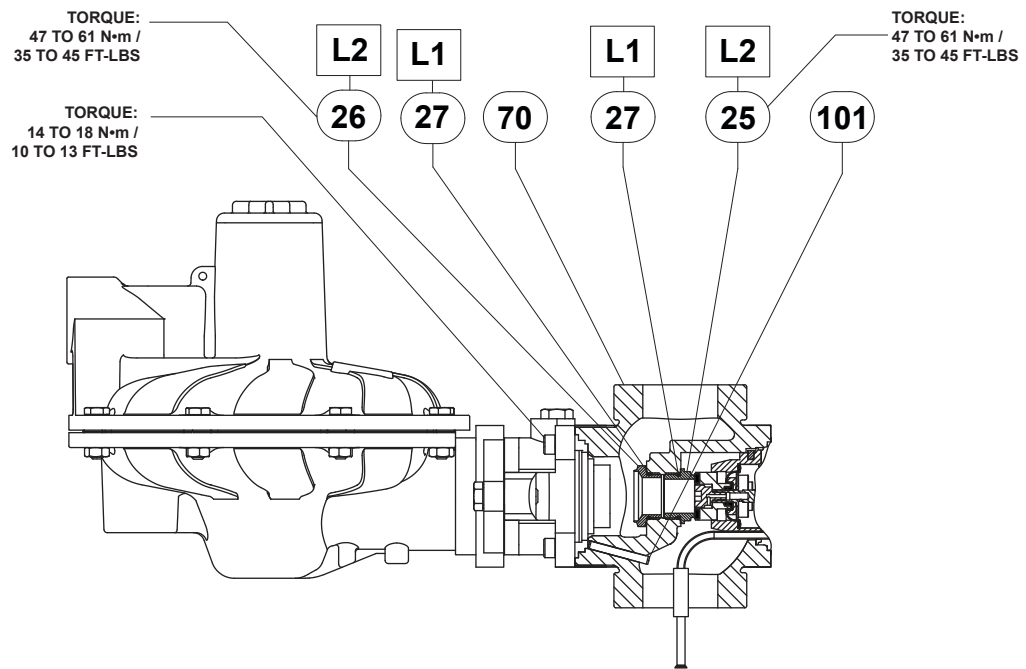

INTEGRAL TRUE-MONITOR™ ASSEMBLY

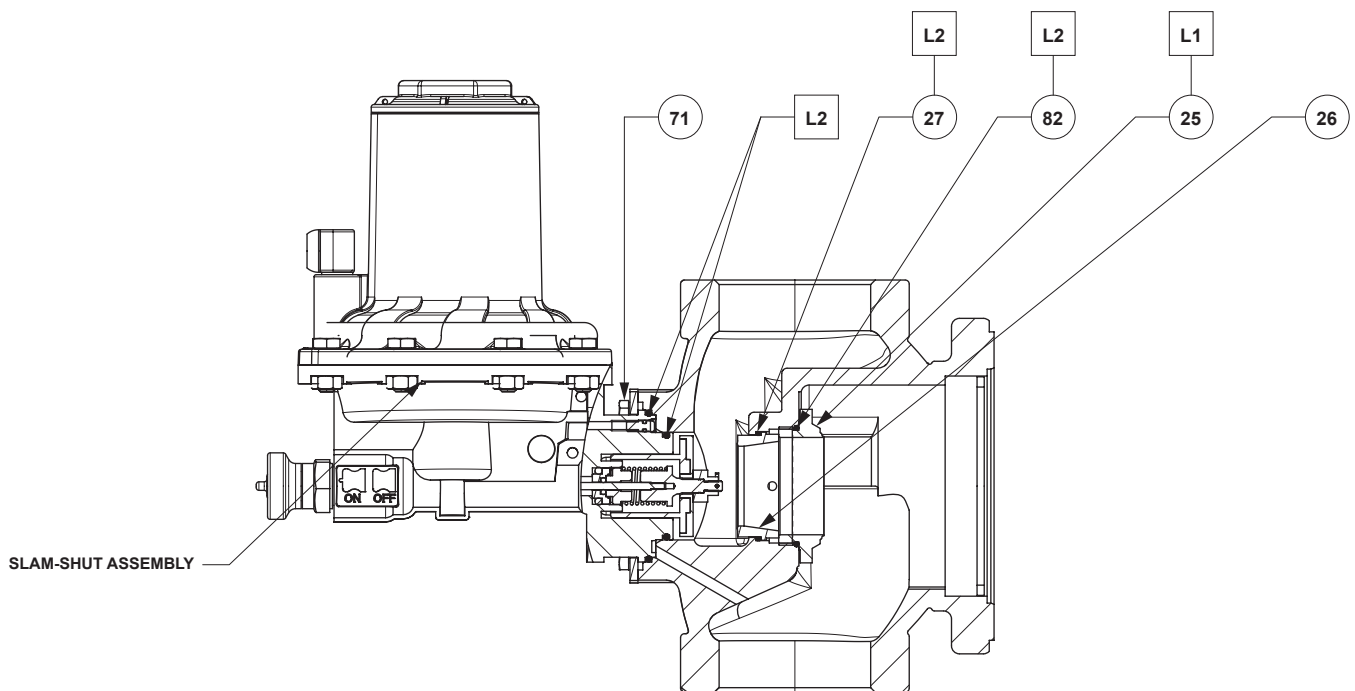

ORIFICE AND SLAM-SHUT ASSEMBLY

GE32407_AE

☐ APPLY LUBRICANT⁽¹⁾:

L2 = EXTREME LOW-TEMPERATURE BEARING GREASE

1. Lubricants must be selected such that they meet the temperature requirements.

Figure 15. CSB400 Series Slam-shut and Integral True-Monitor Modules


CSB400 Series

 Webadmin.Regulators@emerson.com

 Fisher.com

 Facebook.com/EmersonAutomationSolutions

 LinkedIn.com/company/emerson-automation-solutions

 Twitter.com/emr_automation

Emerson Automation Solutions

Americas

McKinney, Texas 75070 USA
T +1 800 558 5853
+1 972 548 3574

Europe

Bologna 40013, Italy
T +39 051 419 0611

Asia Pacific

Singapore 128461, Singapore
T +65 6777 8211

Middle East and Africa

Dubai, United Arab Emirates
T +971 4 811 8100

D103123X012 © 2009, 2018 Emerson Process Management Regulator Technologies, Inc. All rights reserved. 05/18.

The Emerson logo is a trademark and service mark of Emerson Electric Co. All other marks are the property of their prospective owners. Fisher™ is a mark owned by Fisher Controls International LLC, a business of Emerson Automation Solutions.

The contents of this publication are presented for information purposes only, and while effort has been made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available on request. We reserve the right to modify or improve the designs or specifications of our products at any time without notice.

Emerson Process Management Regulator Technologies, Inc does not assume responsibility for the selection, use or maintenance of any product. Responsibility for proper selection, use and maintenance of any Emerson Process Management Regulator Technologies, Inc. product remains solely with the purchaser.



The distinctive swirl pattern cast into every actuator casing uniquely identifies the regulator as part of the Fisher™ brand Commercial Service Regulator family and assures you of the highest-quality engineering, performance, and support traditionally associated with Fisher™ and Tartarini™ regulators. Visit www.fishercommercialservice.com to access interactive applications.

